



4" Sigma Pro



6"/8" Sigma Pro

Table of Contents

Table of Contents	1
Disclaimer	2
Legend	3
Technical Specification	4
General Safety Instructions	5
Installation	6
Changing Installation Configuration	8
Initial Operation.....	11
Maintenance.....	12
Basic Maintenance - Disassembly	13
Basic Maintenance - Assembly	21
Bushing Replacement.....	30
Bill of Materials – 4" Electronic	31
Bill of Materials – 6" Electronic	32
Bill of Materials – 8" Electronic	33
Sigma Pro – Installations of Multiple Units	34
Control Schematic - Electronic Model.....	35
Control Schematic - Electronic Model for 3 Units	36
Control Schematic - Electronic Model for 4 Units	37
Control Schematic - Electronic Model for Multiple Units	38
Troubleshooting	39
Amiad Limited Warranty	0

Disclaimer

Copyright © 2018 Amiad Water Systems Ltd. All rights reserved.

The contents of this document, including without limitation all information and materials, images, illustrations, data, drawings, names and any other such materials that appear in this document are the sole property of Amiad Water Systems Ltd., including any intellectual property rights, whether registered or not, and all know-how contained or embodied therein. Amiad may alter, remove or change the Content without

any further notice. You may not reproduce, copy, modify, create derivative works from, sell or participate in any sale of, or exploit in any way, in whole or in part, any of this document or its content.

The confidential nature of and/or privilege in the file enclosed is not waived or lost as a result of a mistake or error in this file. If you received this file in error, please notify Amiad immediately at info@amiad.com.

This document does not replace any certified drawing, procedure or information provided by Amiad in reference to a specific customer, site or project.

Amiad assumes that all users understand risks involved within this file and/or its attached materials. This document is given in good faith and is not intended to impose any obligation to Amiad. While every effort has been made to ensure the information in this manual is accurate and complete, we would appreciate if you can bring any errors or omissions to the knowledge of Amiad or consult Amiad experts or its authorized representatives if you have any questions.

Amiad Water Systems Ltd. D.N. Galil Elyon 1, 1233500, Israel Tel: 972 4 690 9500 | Fax: 972 4 814 1159 Email: info@amiad.com

Legend



Push



Pull



Screw



Unscrew



Measure



Water
pressure



Attention



Apply



Caution



Read



Center



Sigma Pro
multi-tool



Rotate

Technical Specification

General data	4" Sigma Pro	6" Sigma Pro	8" Sigma Pro
Max. flow rate* (130μ) in average water quality	120 m ³ /h (528 GPM)	180 m ³ /h (792 GPM)	280 m ³ /h (1233 GPM)
Min. operating pressure when cleaning	1.5 bar (22 psi) - electronic controller		
Max. operating pressure	10 bar (145 psi)		
Max. operating temperature	60°C (140°F)		
Filtration area	6000 cm ² (930 in ²)	8000 cm ² (1240 in ²)	
Inlet/Outlet diameter	4" (100 mm) Flange & Victaulic	6" (150 mm) Flange	8" (200 mm) Flange
Weight	Empty: 75 kg (165 lb) Full: 145 kg (320 lb)	Empty: 110 kg (243 lb) Full: 225 kg (496 lb)	Empty: 120 kg (264 lb) Full: 235 kg (518 lb)

* Maximum flow rates depends on water quality and micron size.

Electronic controller	
Control power supply	4 X AA type 1.5V batteries / External 7-14V DC
Solenoid operation data	12-9V DC latching solenoid
DP switch	Integral sensors

Flushing data		
Exhaust valve	2" (50mm)	
Flushing time	10 seconds	
Reject water volume per flush cycle	75 liters (20 gallons)	90 liters (23 gallons)
Min. flow for flushing (at 1.5 bar/22 psi)	34 m ³ /h (150 GPM)	36 m ³ /h (158 GPM)

Construction materials	
Filter housing and lid	RPP (reinforced polypropylene) RPA (reinforced polyamide)
Screens	Molded weavewire stainless steel 316L
Cleaning mechanism	PBT (Polybutylene)
Exhaust valve	Polymeric
Seals	EPDM
Control command tubing	PE (Polyethylene)

Standard filtration degrees						
Micron	500	300	200	130	100	80
mm	0.5	0.3	0.2	0.13	0.1	0.08

General Safety Instructions

- Amiad Water Systems Ltd. ("Amiad") filtration products operate as components in a larger system. It is essential for the system designers, installers, and operators to comply with all the relevant safety standards and regulations, including the use and wear of appropriate safety equipment.
- Prior to installation, operation, maintenance, or any other type of action carried out on the filter, carefully read the safety, installation, operation and warranty instructions.
- During installation, operation, commissioning, or maintenance of the filter, all conventional safety instructions should be observed to avoid danger to any person, including the workers performing the said activity, or to property in the vicinity.
- Please note: the filter enters a flushing mode automatically, without warning.
- Manual cleaning of filter element using high water pressure or steam should be performed in accordance with the cleaning system instructions, the local standards, and regulations.
- Manual cleaning of filter element using acid or other chemical agents should be performed in accordance with the relevant material safety instructions, the local standards, and regulations.

Observe and act according to the requirements detailed in the safety stickers on the filter, if any.

Tools needed for installation



Grease
760190-000127



Flathead screwdriver

**Use only with
Rinse controller**



Open wrench
11mm (1/4")



Sigma Pro multi-tool
710101-001445

Use only appropriate standard tools and equipment operated by qualified operators when installing, operating and maintaining the filter.

*Amiad supplies the Sigma Pro multi-tool only.

Installation

General

- Install the filter according to the detailed Installation Instructions provided with the filter by Amiad.
- Make sure to leave enough space (height 70 cm/ 27") to enable easy access for future treatments and safe maintenance operations.
- The user should arrange suitable lighting at the area of the filter to enable good visibility and safe maintenance.
- Check and retighten all bolts during commissioning and after the first week of operation.
- Use only appropriate tools and equipment or recommended tools and equipment, if any, all operated by qualified operators when installing, operating, and maintaining the filter.

Civil Engineering

- While using lifting equipment, make sure that the filter is lifted in a safe manner.
- Do not leave equipment lifted if not necessary. Avoid working below lifted equipment.

Shipping and Transporting

- Shipping and transporting the filter must be done in a safe and stable manner and in accordance with the relevant standards and regulations.
- For shipping, lifting and positioning the filter, use only approved lifting equipment and authorized employees and contractors.
- Whenever lifting the filter is required, connect suitable hoisting equipment to the filter's clamps at both sides of the filter, connect the ropes to a crane hook and carefully lift the filter.



Hydraulics


- The user should install a manual water cut-off valve next to the filter's inlet port.
- In installations where the piping network downstream of the filter is pressurized, an additional manual water cut-off valve should be installed next to the filter's outlet port.
- The user should make sure that the system includes a pressure release / drainage valve to enable release of residual pressure prior to any maintenance procedure is performed on the filter.
- The user should make sure that the filter is never exposed to water pressure exceeding the maximum designated pressure for this filter. When necessary, a pressure reduction valve should be installed upstream of the filter's water inlet port.
- Please note that the maximum working pressure indicated in the filter's specifications table includes the pressure caused by fluid hammer and pressure surge effects.
- If possible, prior to installing the filter, thoroughly flush the main line at the connection point in order to remove large objects that may damage the filter's internal mechanism.

Important installation note

- Install the filter vertically. Please note that a minimum clearance of 70 cm (27") is required in order to disassemble the unit.

Attention

- Ensure that the direction of the flow is aligned with the arrows marked on the filter housing.
- To prevent static backpressure or reverse flow through the filter, it is recommended to install a non-return valve.

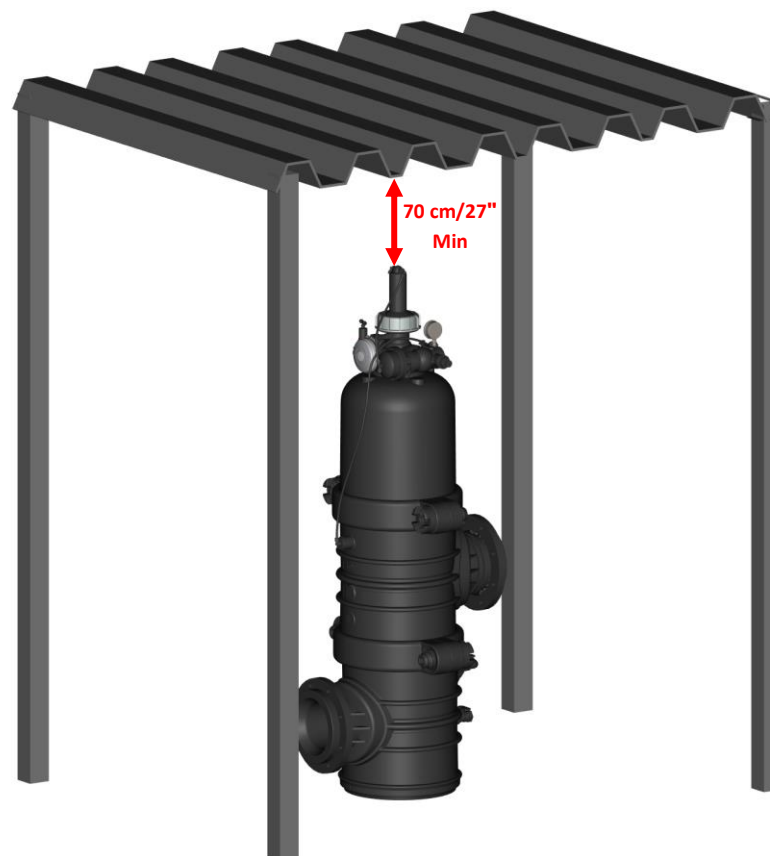


Changing Installation Configuration

Changing the inlet/outlet direction:


If the original configuration does not match the required installation position, the lower body can be rotated 360°.

In order to change the configuration of the filter, follow these steps:


1. Disassemble the filter according to "Basic Maintenance Disassembly" (on page 13)
2. Disconnect the pipeline from the Sigma lower body
3. Remove the clamps that connect the Sigma body to the lower body

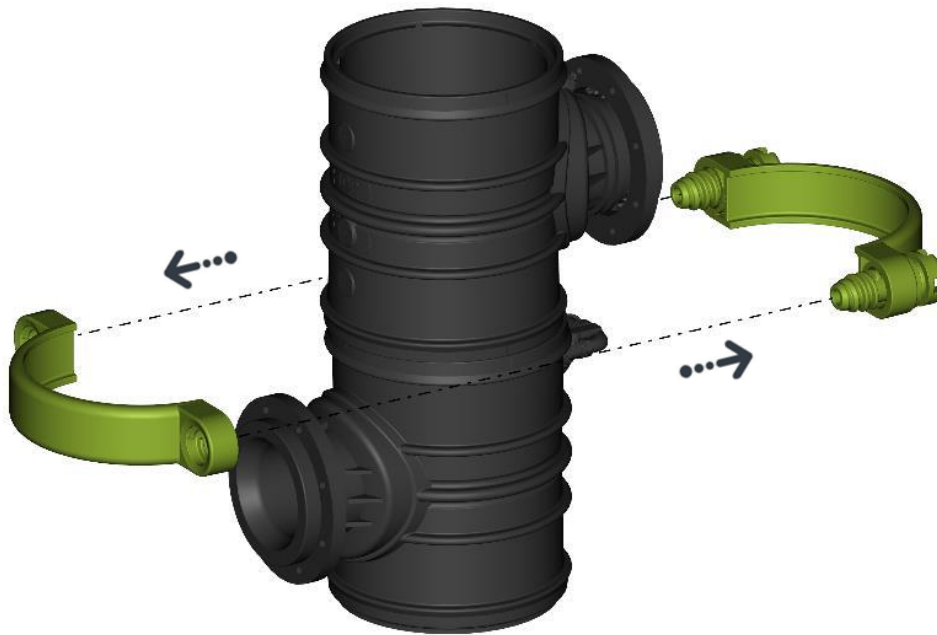


4. Lift and rotate the Sigma body and plate to the desired position

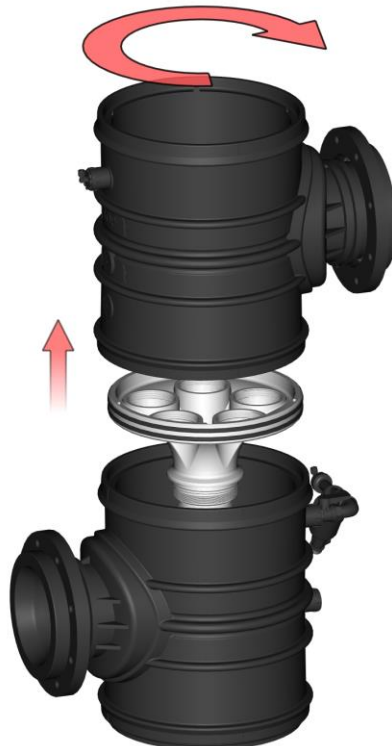


5. Make sure that the fittings on the Sigma body are set in place with the lower body

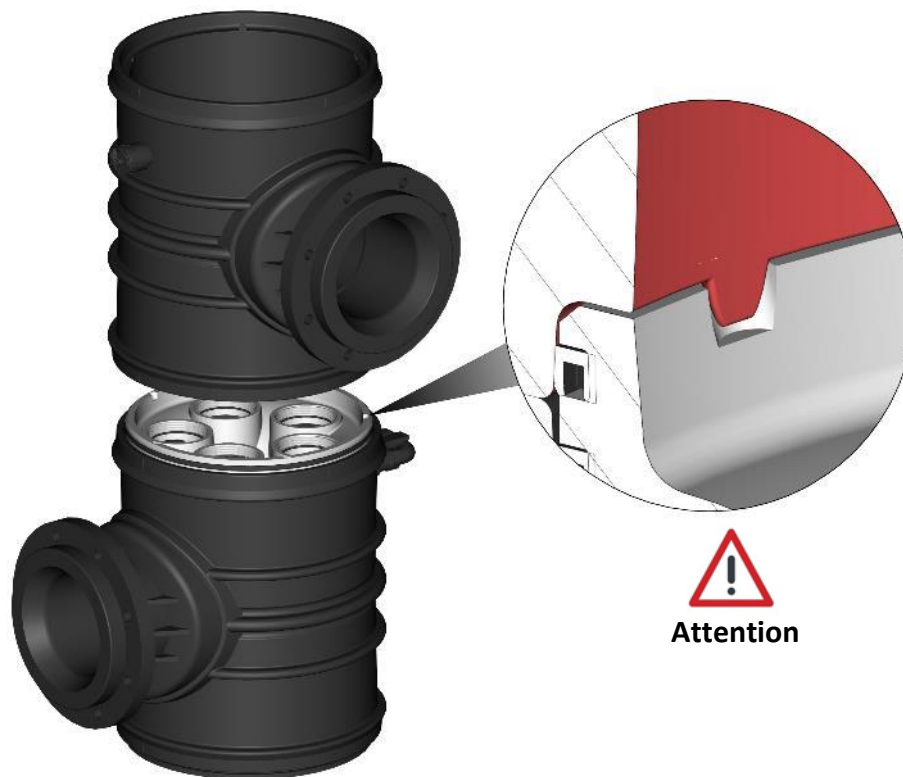

6. Connect the Sigma body to the lower body in the desired position

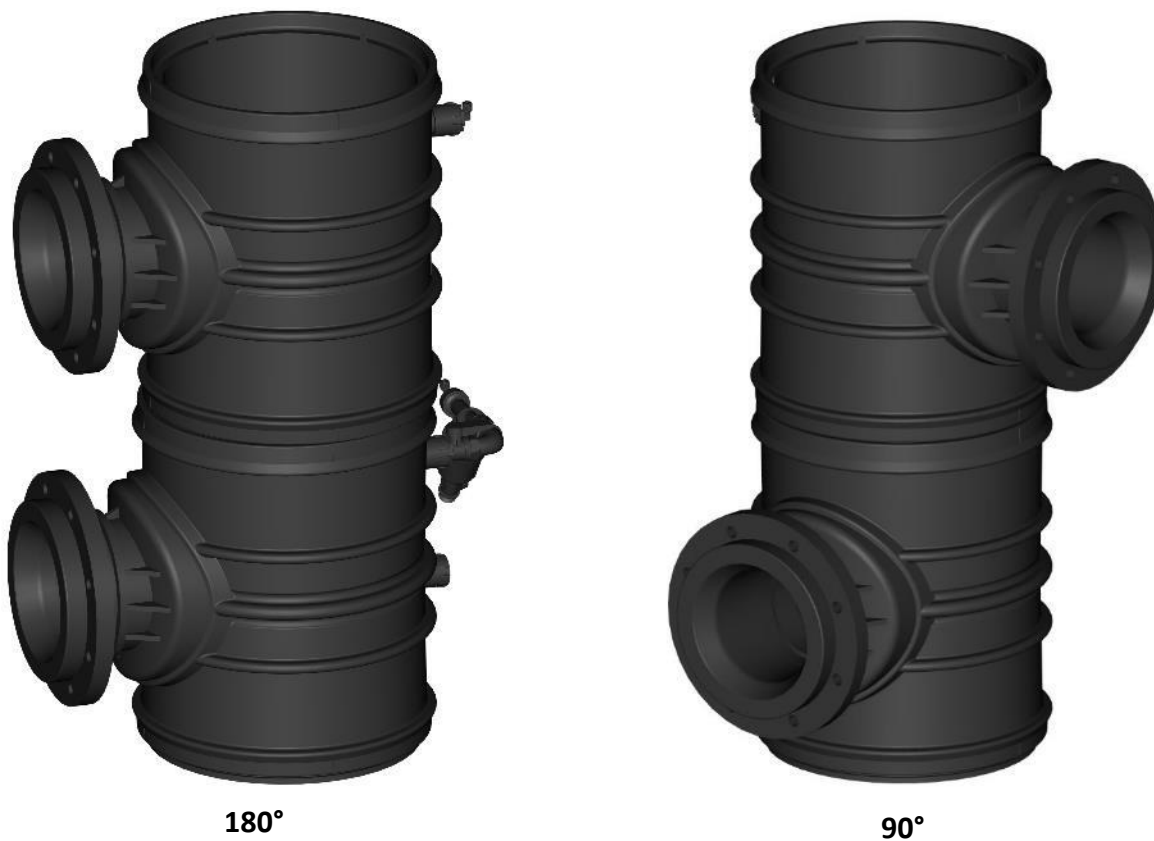

7. Connect the clamps and tighten the bolts using the Sigma multi-tool

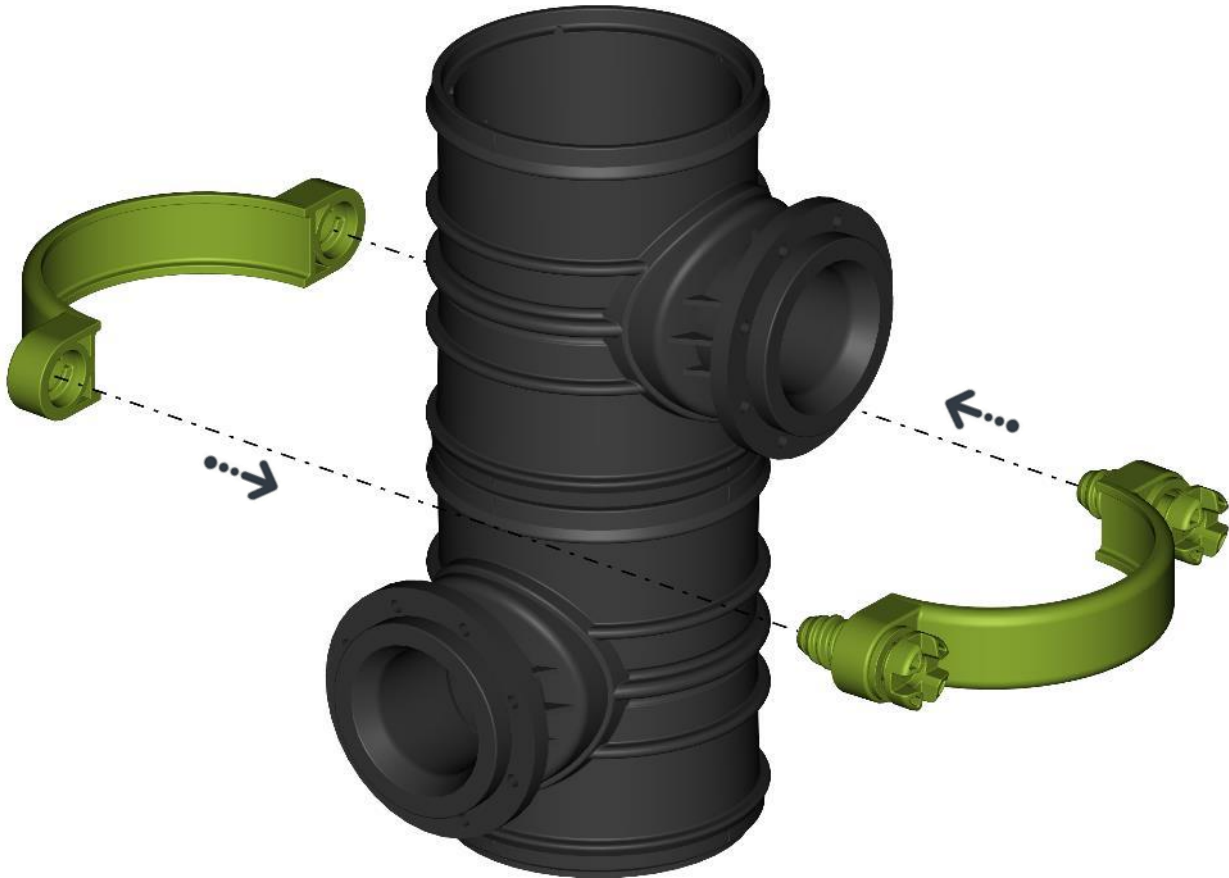

8. Assemble the filter according to chapter "Basic Maintenance assembly" (on page 21).

Initial Operation

At the beginning/end of the growing season, or, in case of malfunction:

- Carefully read this Installation & Operation manual prior to any attempt to operate the filter.
- In order to achieve maximum performance and smooth operation of the filter, it is crucial to perform the start-up and first operation procedures exactly as described in this manual.
- An authorized technician should commission the filter. Do not attempt to commission the filter unaccompanied as it will affect your warranty coverage.
- Open the inlet valve while the outlet valve remains closed.
- Open the outlet valve slowly.
- Make sure there are no leaks in the filter.
- Perform a manual flush two times.
- If flow increases and pressure drops dramatically for a long period of time during network filling-up, it is recommended that a pressure sustaining valve be installed downstream of the filter. The pressure sustaining valve ensures a controlled filling-up of the line.
- If continual water flow is essential even during maintenance period, it is recommended that a manual or automatic bypass valve be installed together with the isolating valves that can be used to isolate each filter unit.


Before any maintenance operation, please read the following:

- Installation, operation and maintenance should be done by technicians acting strictly in accordance with Amiad's instructions and in accordance with this manual. Other service should only be done by technicians authorized by Amiad.
- Disconnect the filter from the water system by closing and securing the manual inlet valve. In cases where the downstream piping network is pressurized, close and secure the manual outlet valve.
- Release the residual water pressure by opening the pressure release / drainage valve.
- Empty the filter by opening the drainage valve.
- Place warning signs around the work area as required by the local standards and procedures.
- Please note the requirements on filter's safety stickers, if any.

Before disconnecting the filter from the water supply and before releasing the filter's residual pressure,

DO NOT:

- **Loosen or unscrew bolts**
- **Remove any protection cover**
- **Open any service port flange**

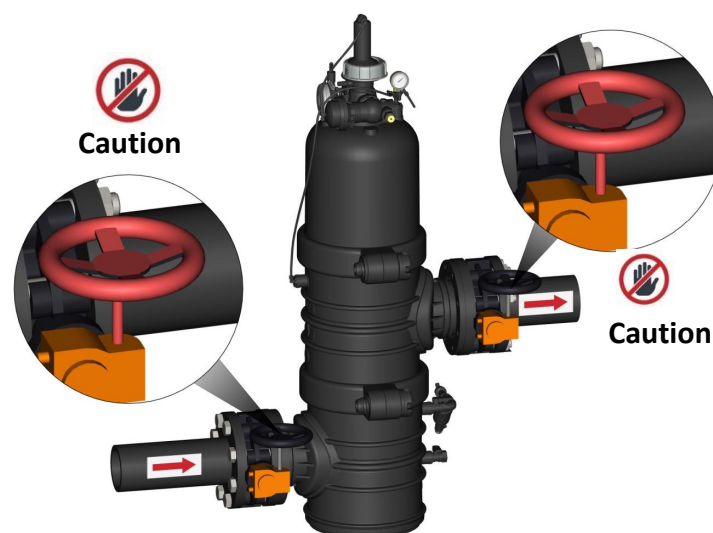

Maintenance

General inspection

A general inspection of the filter operation should be done regularly and prior to any scheduled maintenance procedure. This includes pre-season, post-season, and seasonal check-ups.

General inspection procedure:

1. Initiate a flushing cycle
2. Check that the exhaust valve opens and closes normally
3. Visually check the filter housing and valves for leakage

Note for long-term cessation of filter operation

The following must be done if the filter will not be operated for the season:

1. Perform a flushing cycle (if possible, with a closed downstream valve)
2. Release pressure from the filter and drain it


Avoid damage due to frost

To avoid damages or breakages in the filter, the filter must be drained prior to periods of frost, including the cylinder and command tubes.

Winterization

To avoid damages or breakages in the filter, the filter must be drained prior to periods of frost, including the cylinder and command tubes.

A step by step instructions:

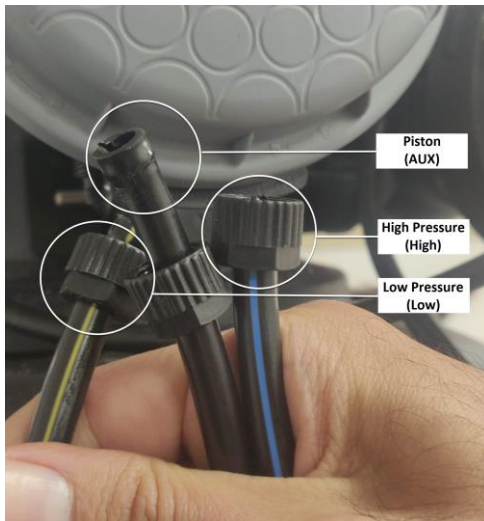


1. Initiate a manual flush to make sure that your screen will be clean for the shutoff period.
2. Close the isolation valves (inlet and outlet)
3. Initiate an additional manual flush to release the pressure inside the filter
4. Open the drainage valve
5. Disconnect the 2 tubes that supply water to the filter piston
6. Release the gray nut that tighten the piston in place
7. Pull out the piston and drain the water from the piston
8. Re-assemble the piston
9. Mark the tubes that are linked to the ADI-P controller and disconnect it from the controller for the duration of the winter season

Before any maintenance operation, please read the following:

- Installation, operation and maintenance should be performed by technicians in accordance with Amiad's instructions and in accordance with this manual. Other service should only be done by authorized technicians.
- Disconnect the filter from the water system by closing and securing the manual inlet valve. In cases where the downstream piping network is pressurized, close and secure the manual outlet valve.
- Release the residual water pressure by opening the pressure release/ drainage valve.
- Empty the filter by opening the drainage valve.

Basic Maintenance - Disassembly

1. Perform manual flush (please see **ADI-P** manual):
 - a. Close the filter's outlet valve
 - b. Perform a manual flushing with the controller

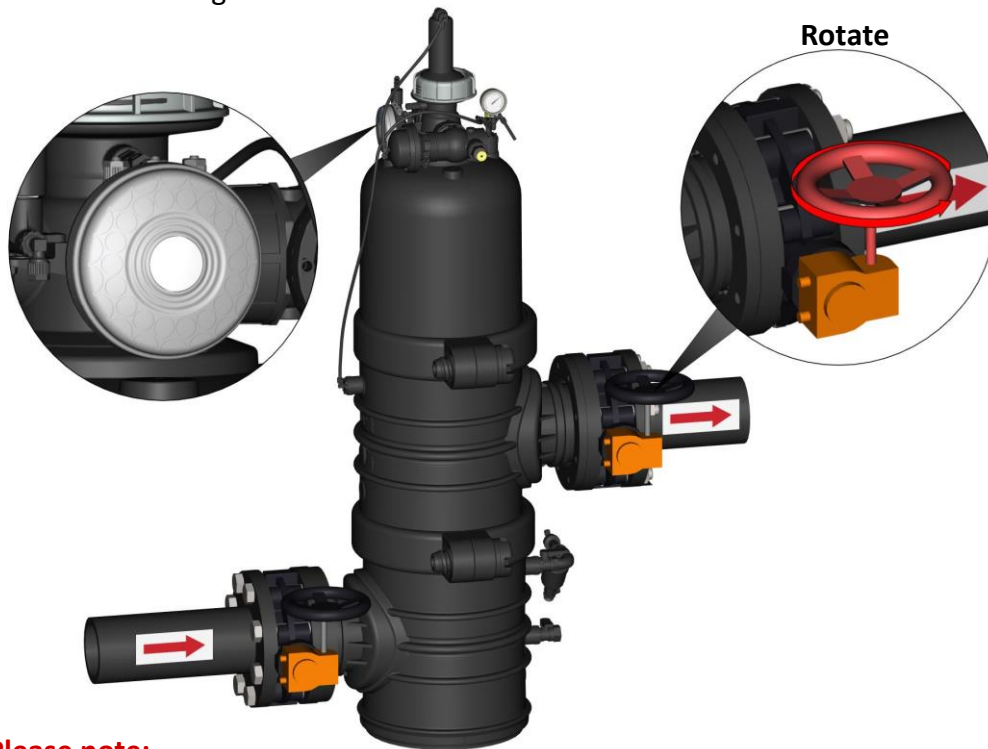


Attention

Please note:


Always open and close the valves slowly and gradually!

The filter enters a flushing mode automatically, without warning.


2. Close the filter's inlet valve
3. Drain the filter by opening the manual drain valve

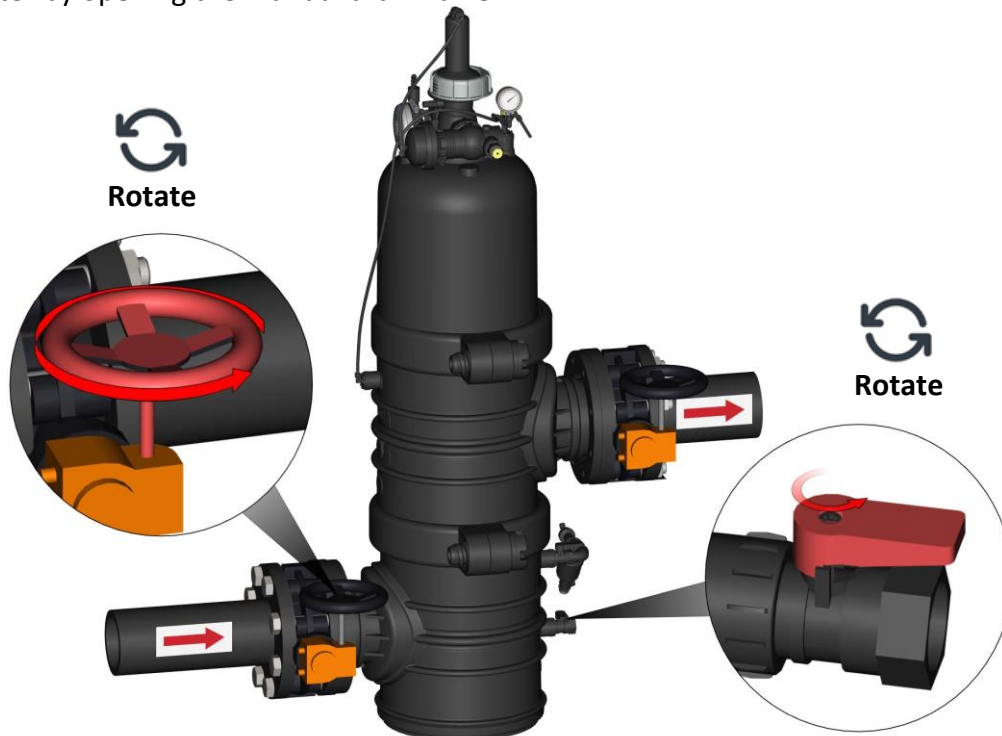

4. Make sure that the pressure gauge is on zero!

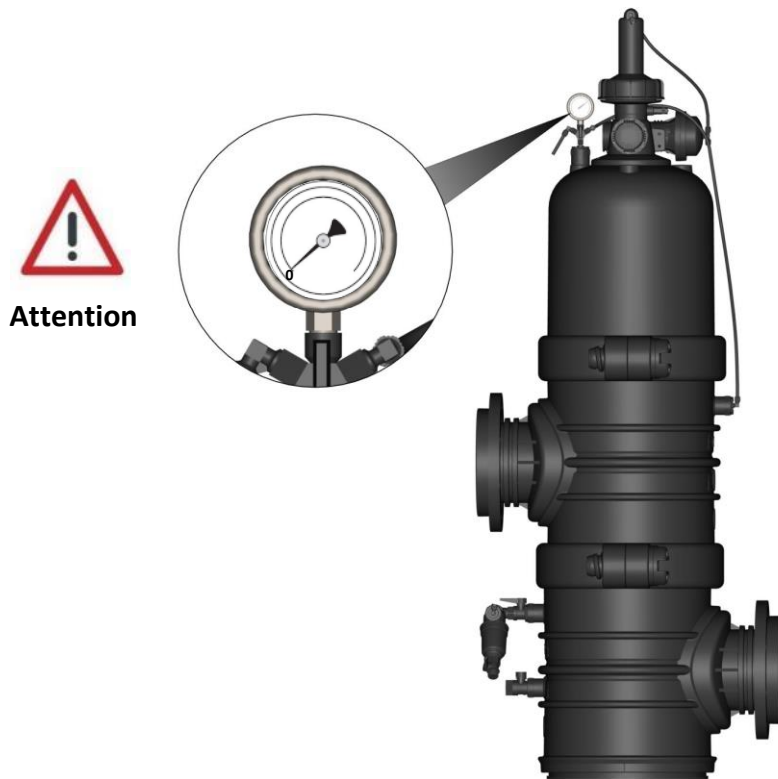


5. Disconnect the command tubes:
a. Pull up the command tube

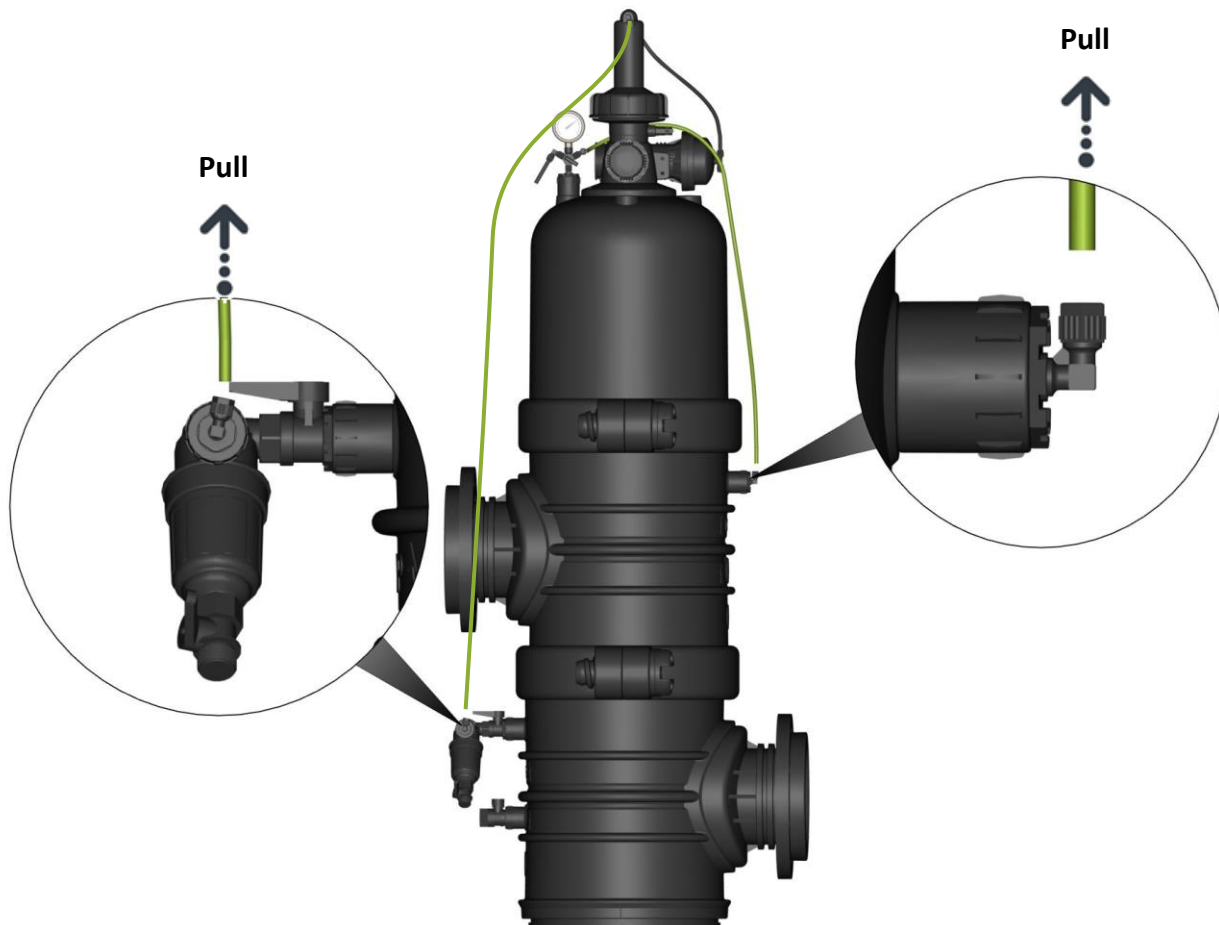


6. Release the upper clamp:


- a. Using the Sigma multi-tool, unscrew the bolts at both sides of the clamps

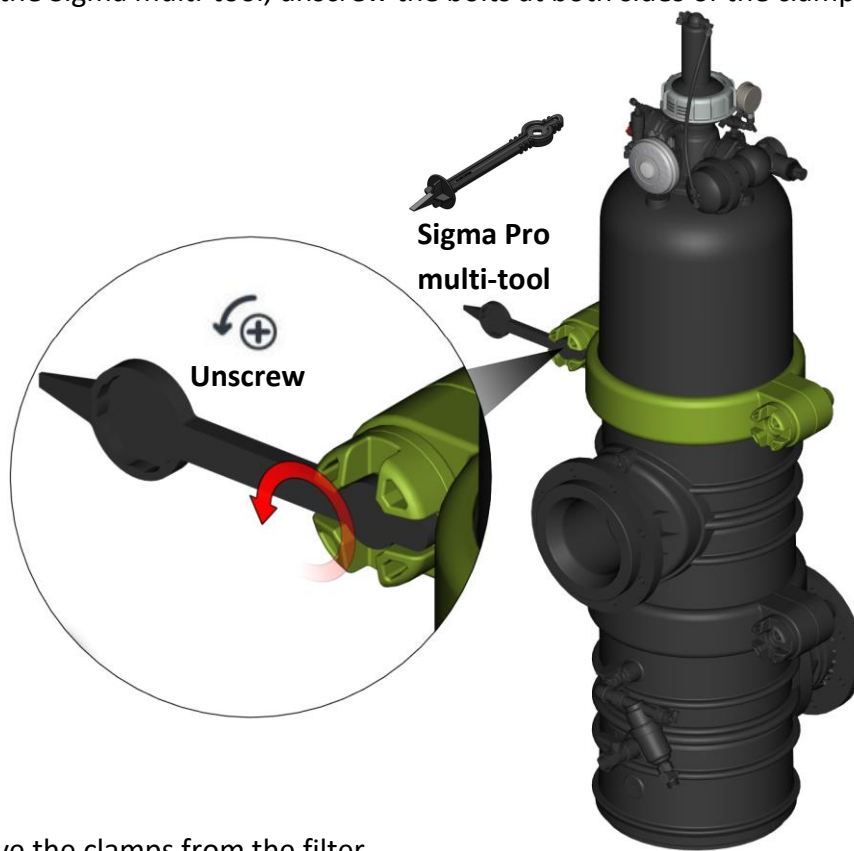

- b. Remove the clamps from the filter

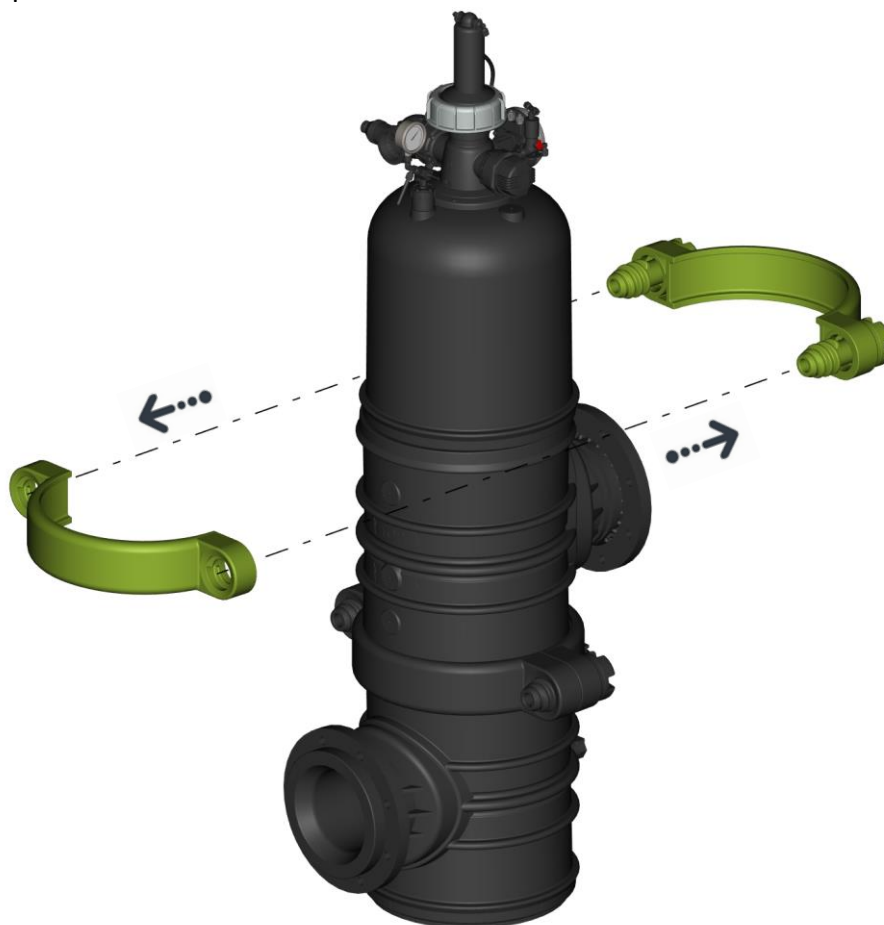


7. Pull up and remove the filter's lid

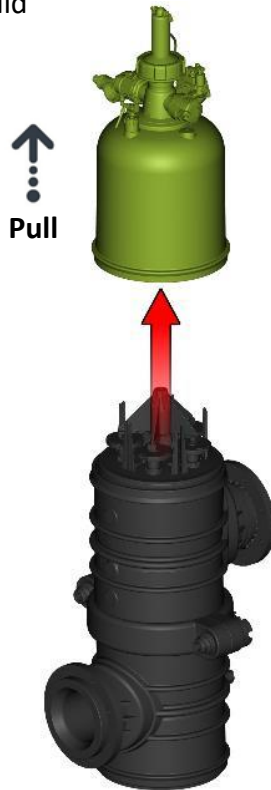

8. Pull up and remove the bridge according to the following steps:

- a. Slide open the bridge clip x5 to disconnect the bridge from the turbine
- b. Pull up and remove the bridge

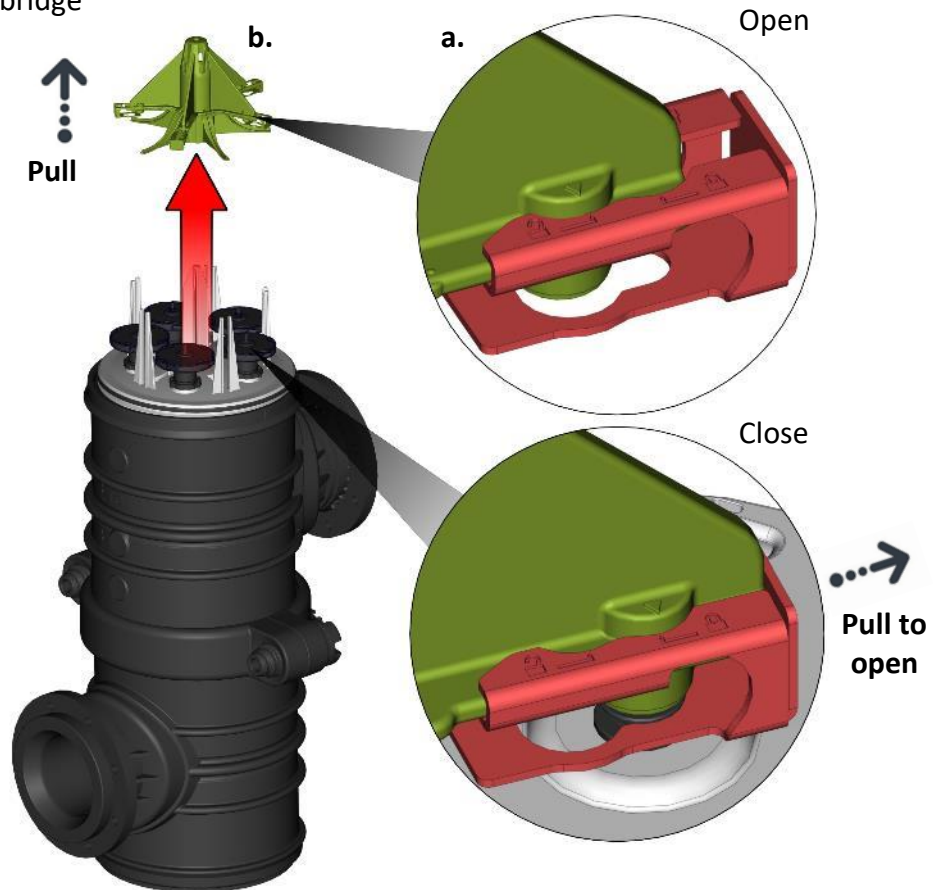


9. Remove the turbine from the five suction-scanner's upper shaft




10. Remove the suction-scanner's top plate:

- a. Place the Sigma multi-tool between the top plate grooves
- b. Gently press down on the Sigma multi-tool and lift the top plate

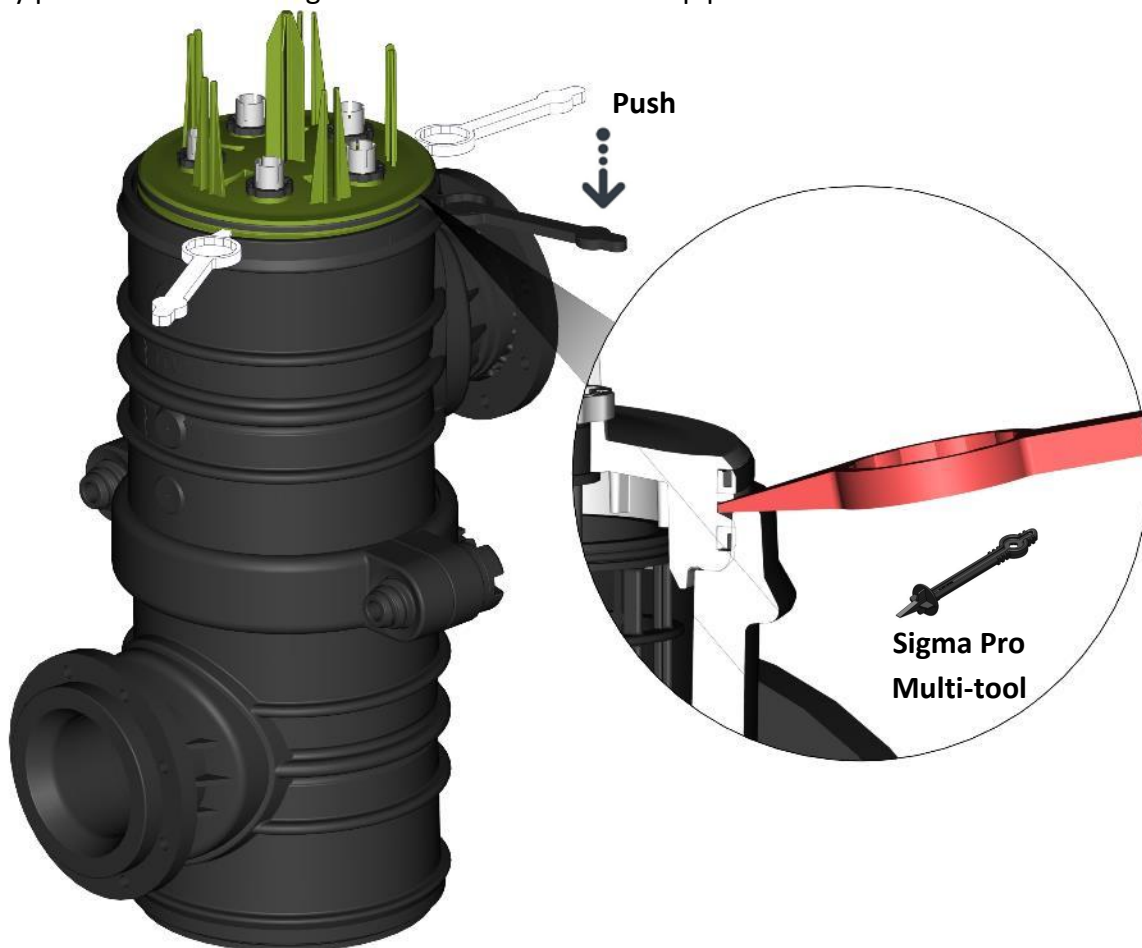


c. Remove suction-scanner's top plate

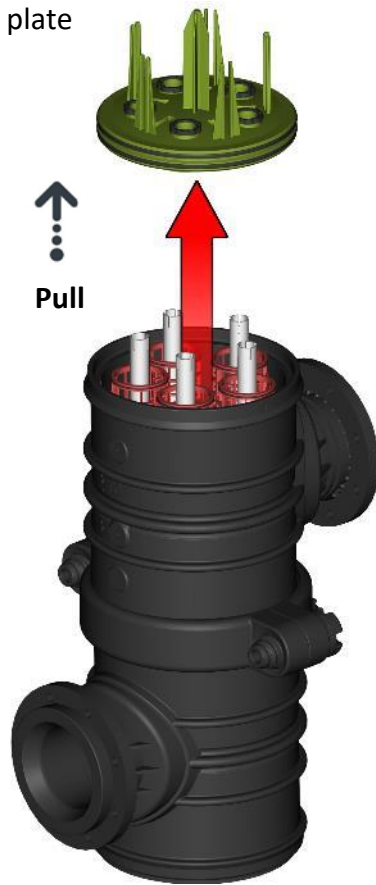

11. Replace the gaskets if needed

- a. Remove the used gaskets
- b. Insert new gaskets, making sure that the open side of the gaskets are turned out as shown

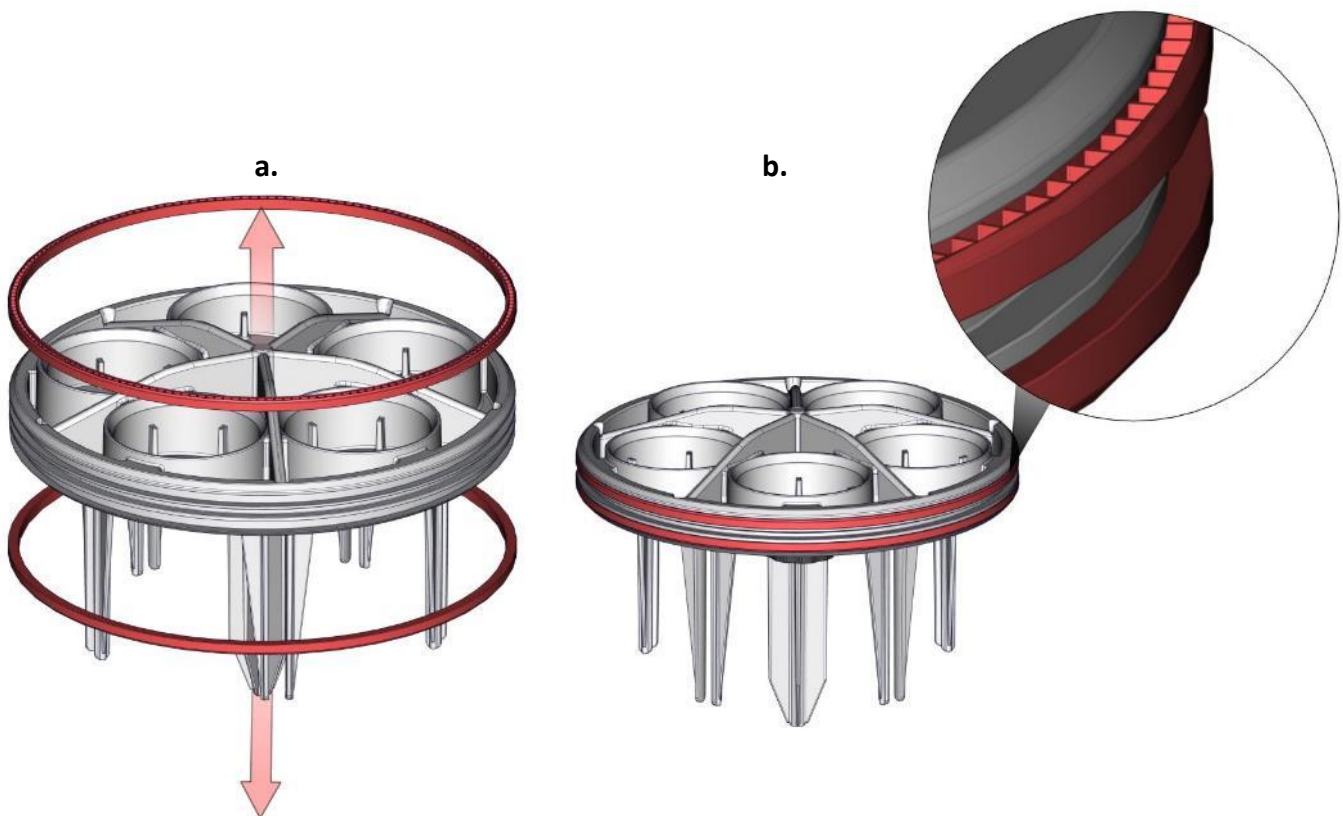

12. Remove the five suction-scanners out of the screens:



13. Remove the five screen units:
- Coarse and fine screen together




Before the re-assembly:

- a. Make sure that all parts below are undamaged
- b. Replace dry or damaged gaskets and o-rings
- c. Make sure that the coarse screen is clean
- d. Apply silicon grease on the o-rings (760190-000127 – tube of grease PG-21)



Clamps

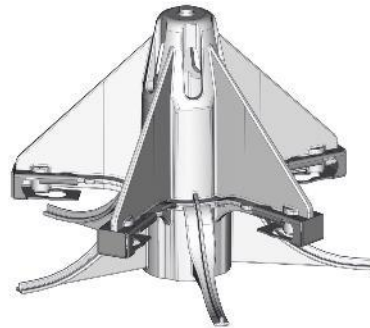

Bridge




Top plate



Turbines




**Scanners and
Nozzles**

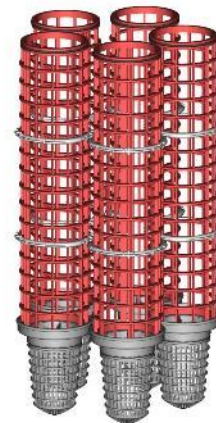


**Fine and
Coarse Screen**

Basic Maintenance - Assembly


1. Insert the five screens into the filter housing:
 - a. Make sure that the o-ring is in place

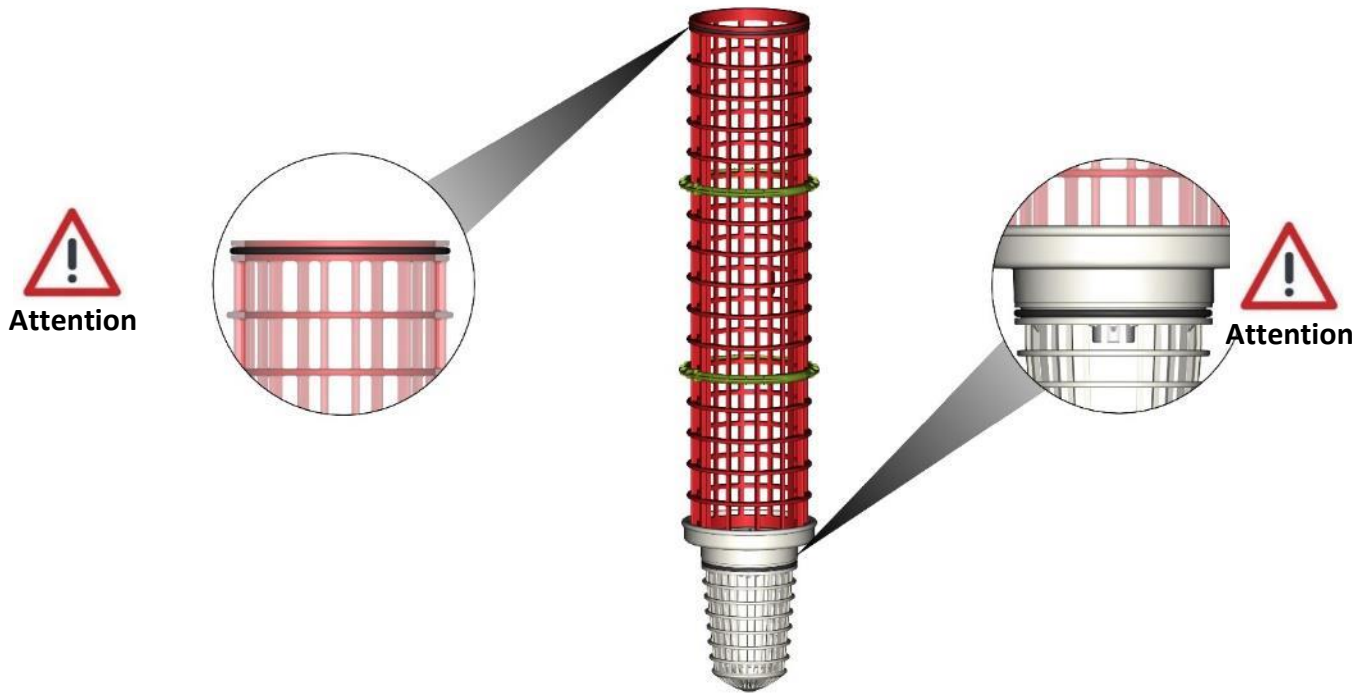

- b. Insert the five screens into place

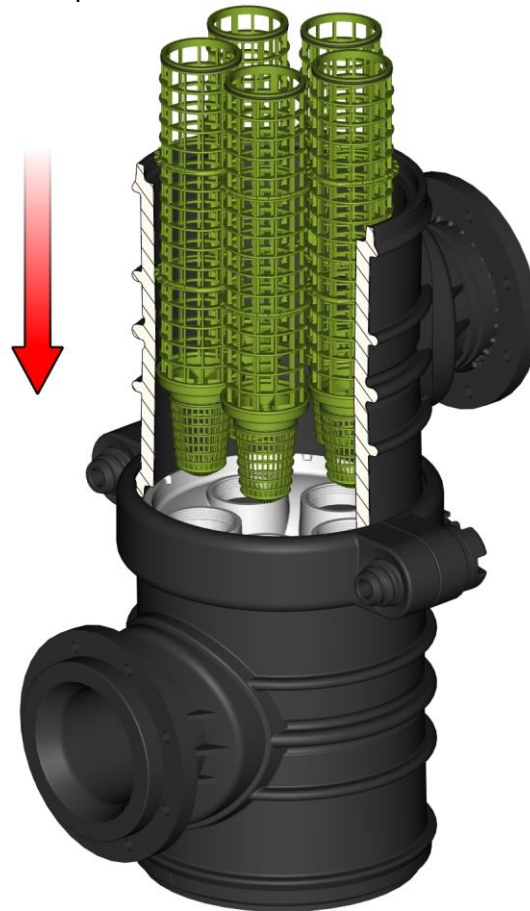


2. Insert the five suction-scanners into place

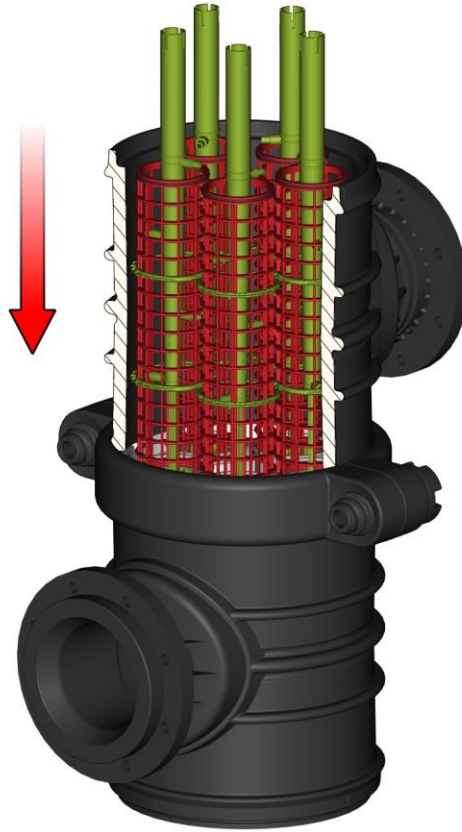


Make sure that each scanner shaft passes through its socket at the center of its designated coarse screen.




Center

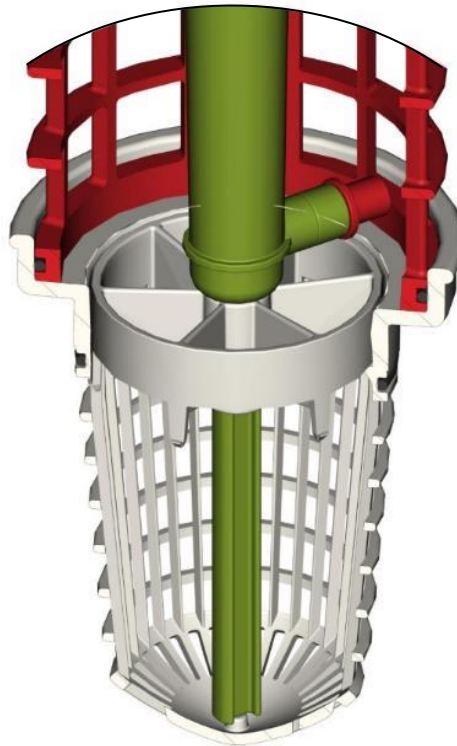


3. Re-install the suction-scanner's top plate:
 - a. Make sure the seal is in place and the open side of the seals turn out as shown
 - b. Apply 760190-000127 grease to the seals
 - c. Make sure the seals are intact

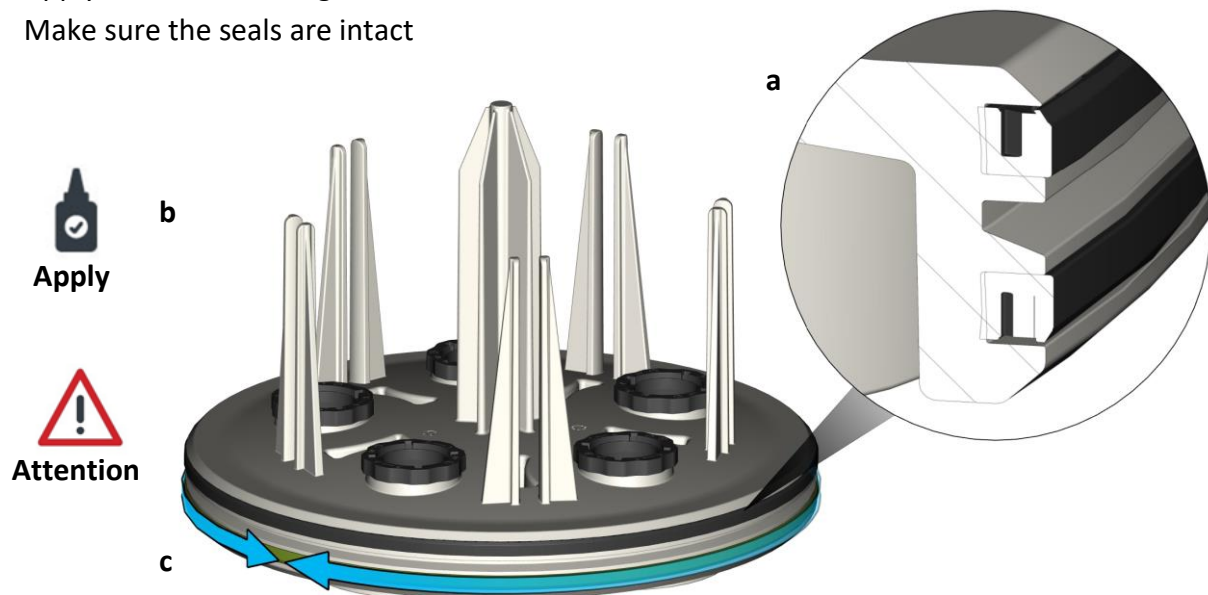

- d. Avoid damaging the seal during plate insertion
- e. Rotate the suction-scanners, making sure that it rotates freely

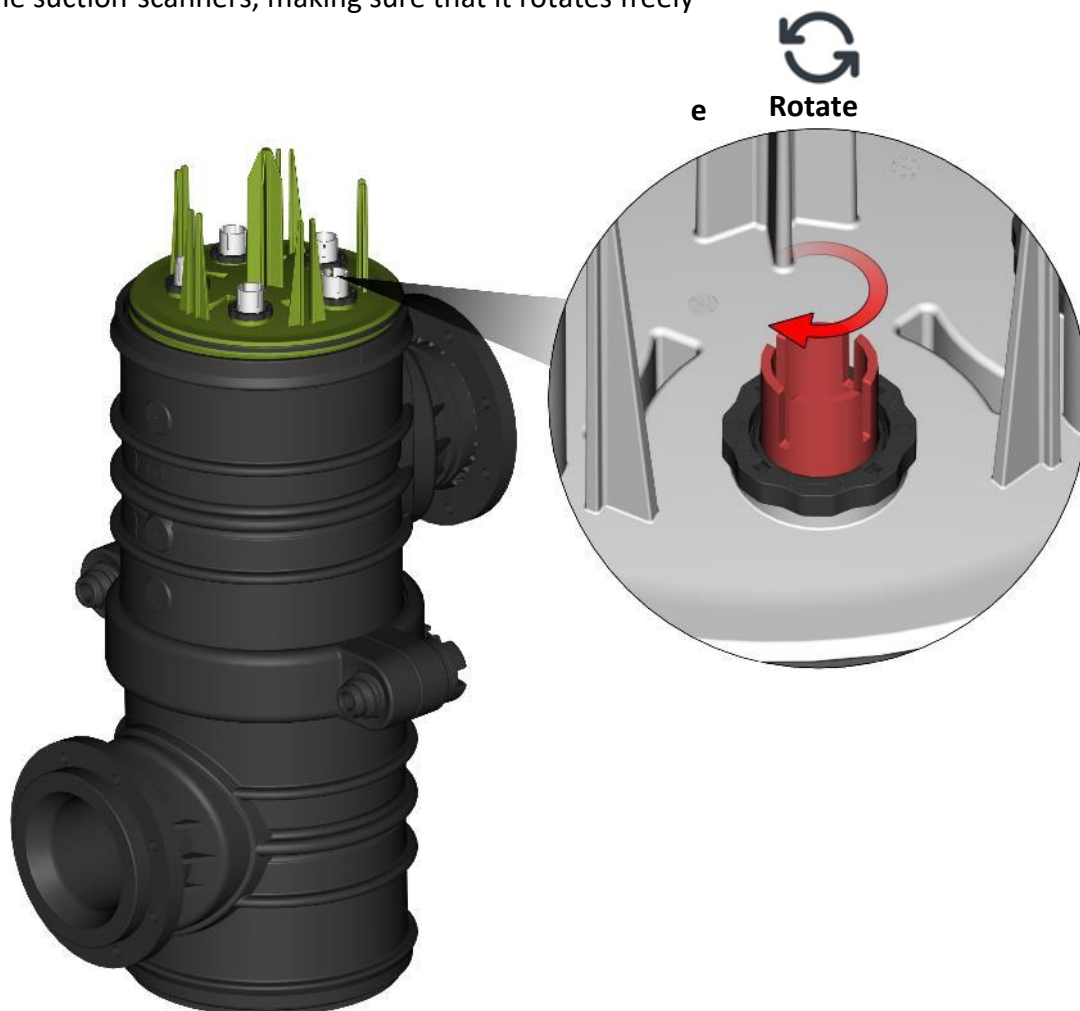


- f. Make sure that the plate is inserted correctly and creates a caulking between the bottom and the top

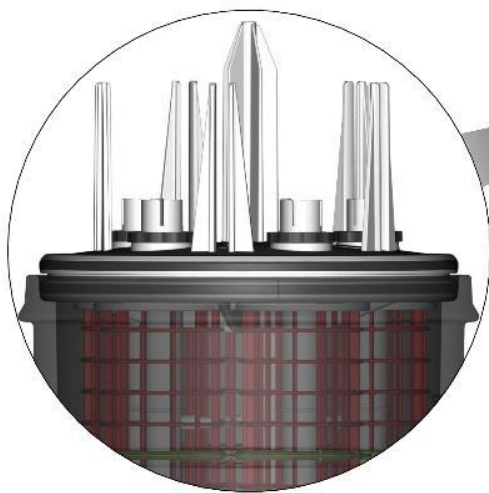


4. Install the turbine on the scanners



5. Install the bridge according to the following steps:
 - a. Insert the bridge on the top plate
 - b. Lock the five bridge clips on the turbine's edges

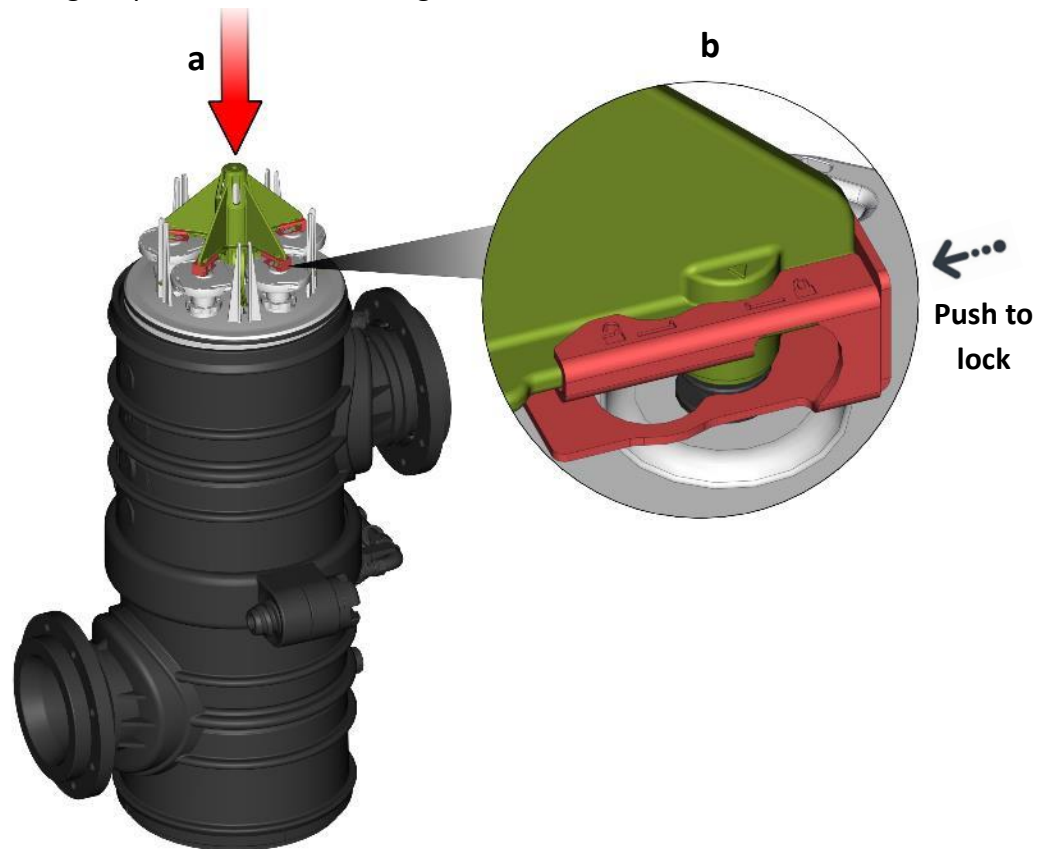


6. Rotate the turbines, making sure that all five turbines rotate freely

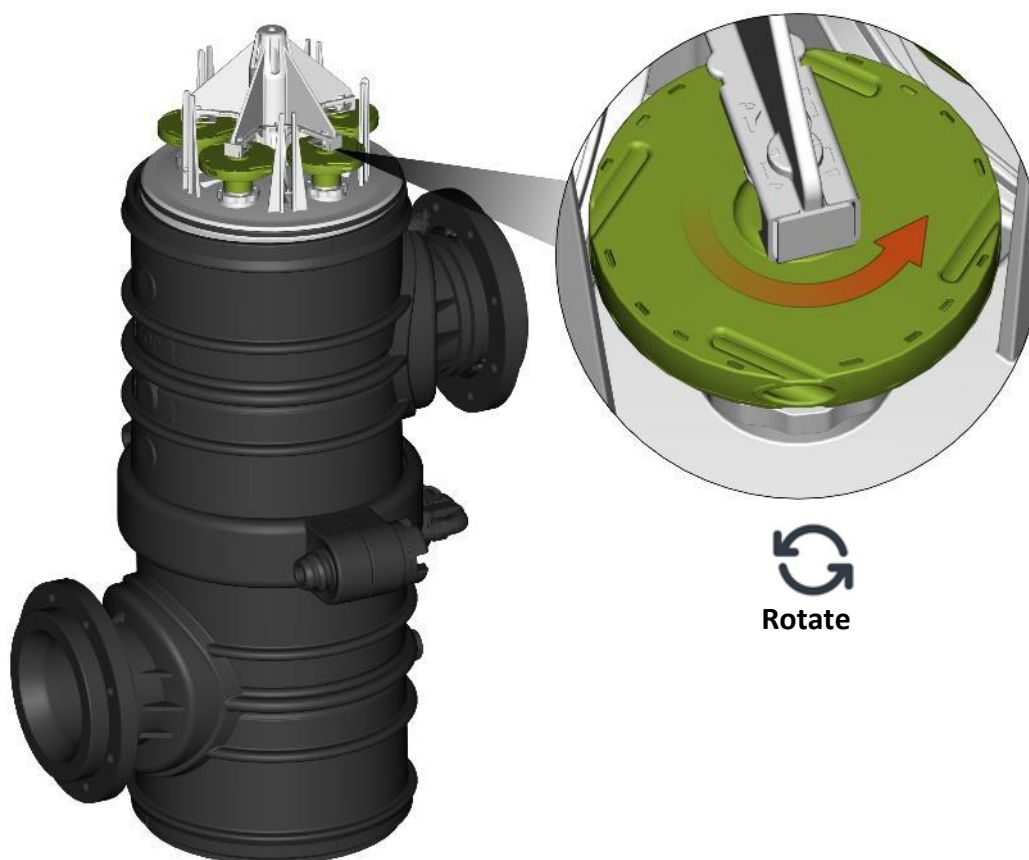


7. Lift the bridge up and down to make sure all turbines connect to the bridge and the scanners move freely




8. Re-install the filter cover:
Paying attention to not damage the seal during the cover installation

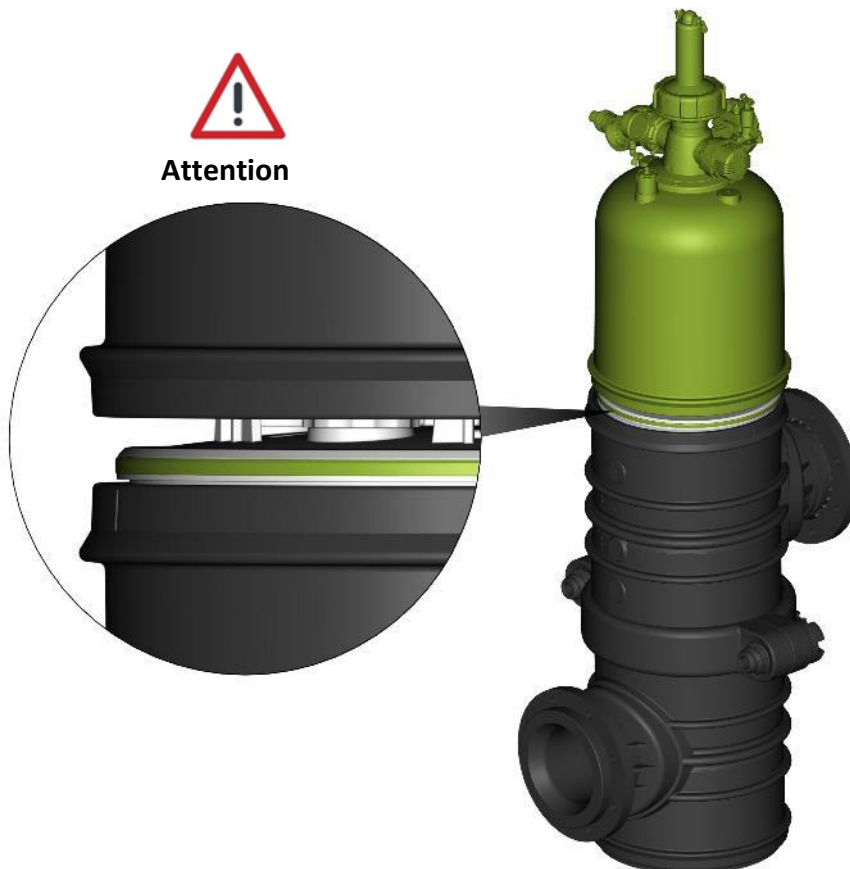

9. Re-install the upper clamp:
- Tighten screws gradually

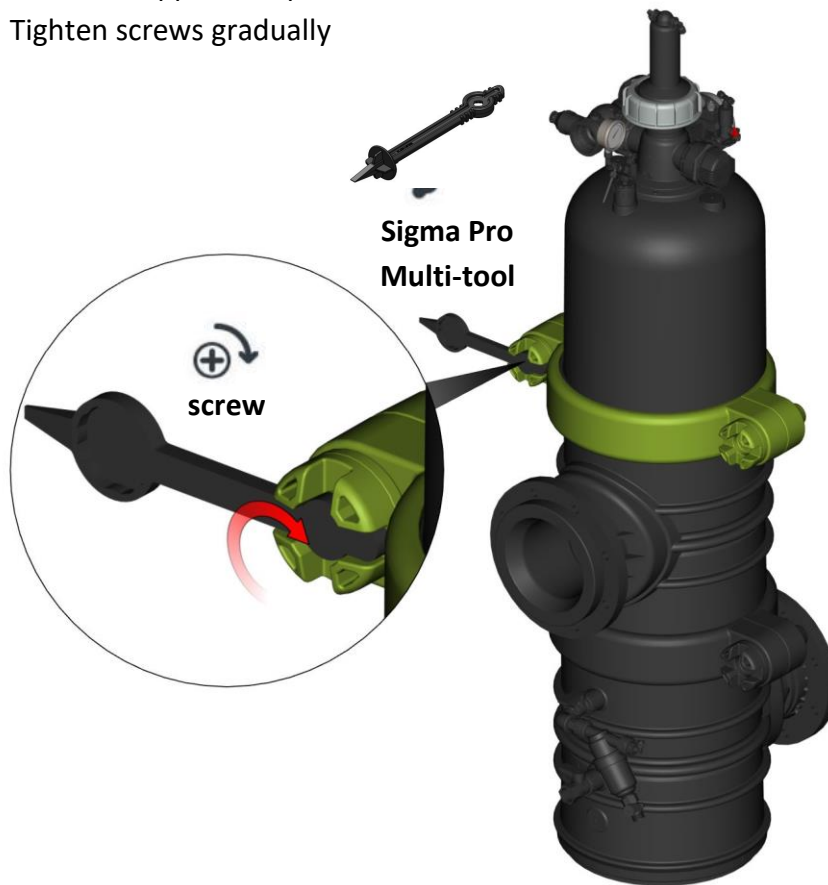

10. Connect the command tubes

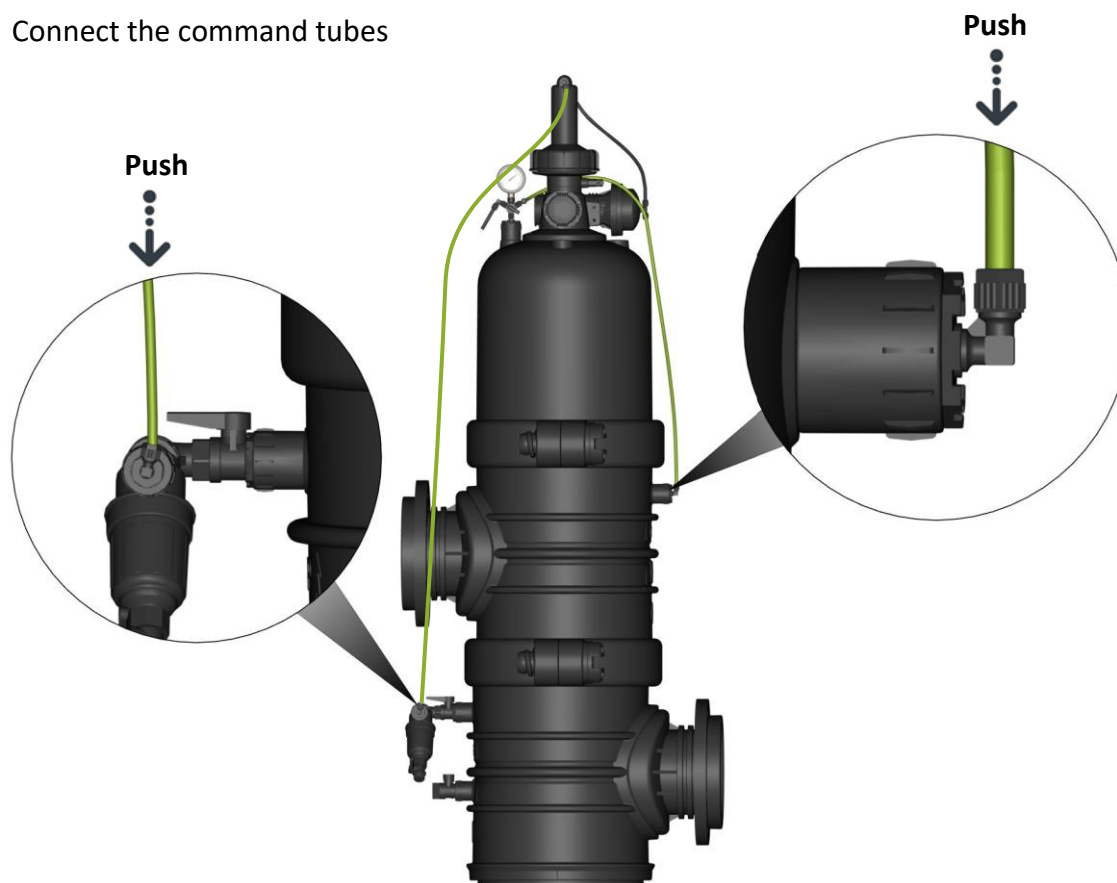


11. Close the manual drain valve



12. Open the filter outlet valve


13. Open the filter inlet valve

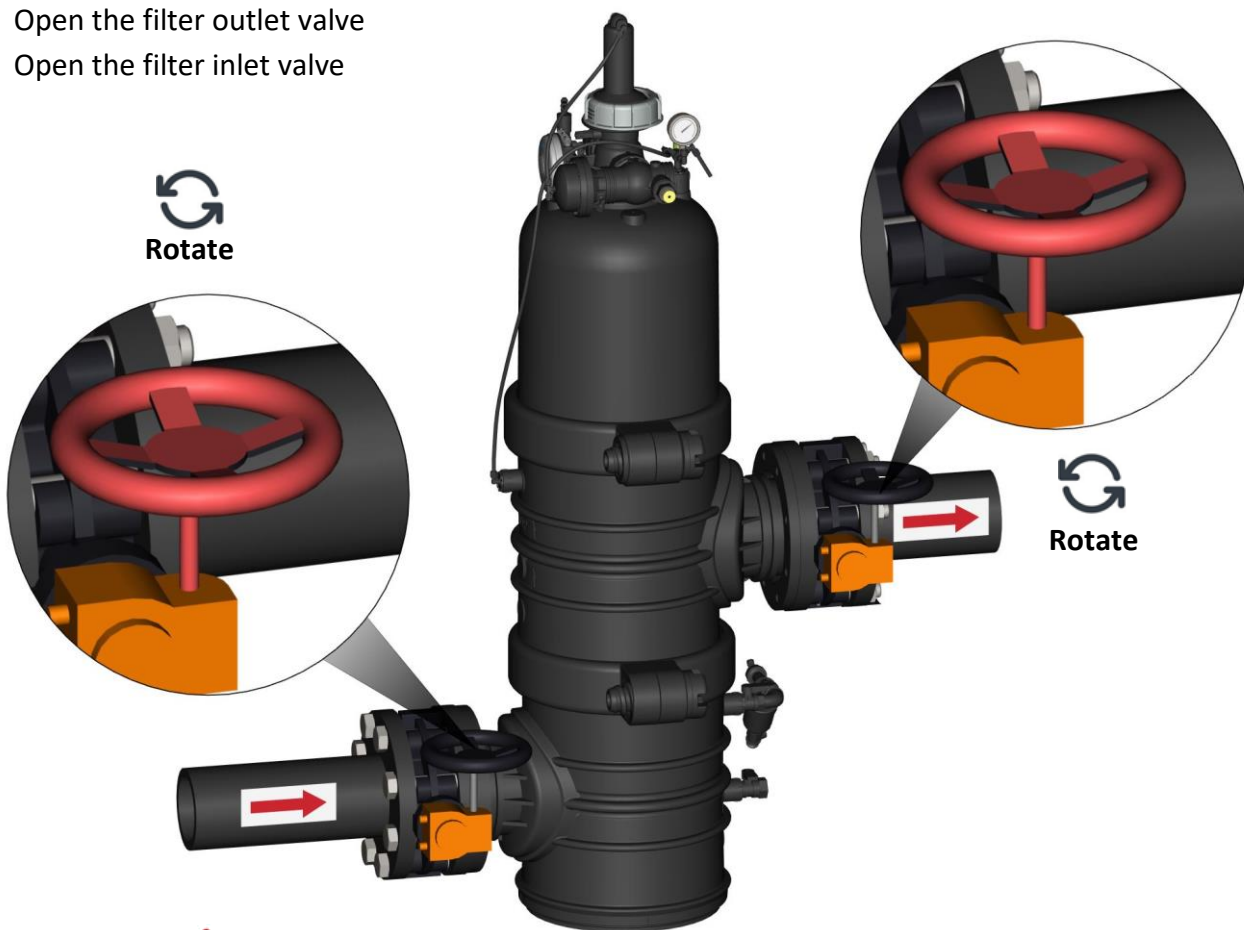

ways open and close the valves slowly and gradually!

14. Operate the Sigma filter

- See "Initial Operation" (on page 11)

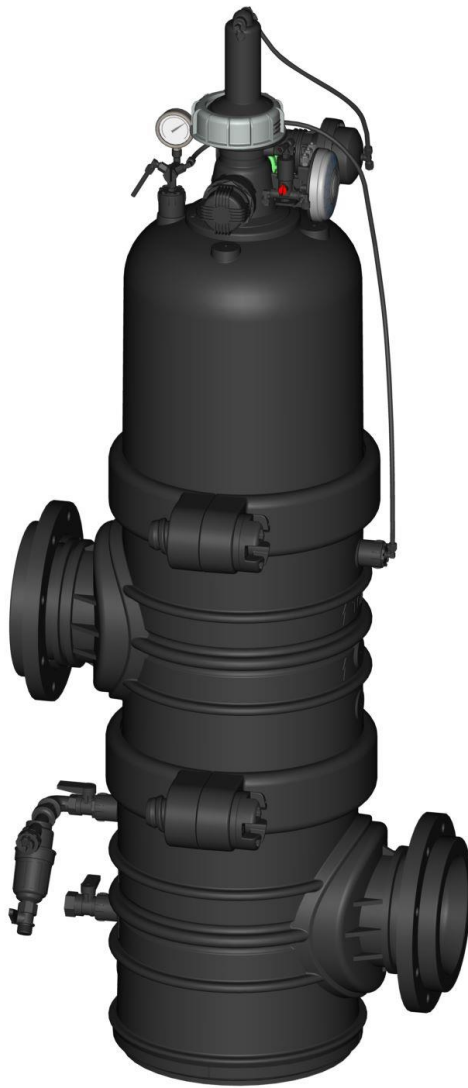


Bushing Replacement


Following extensive use, the bushings may be worn out and should be replaced.

Follow these steps to replace the bushing:


1. Disassemble the top plate, see "Basic Maintenance - Disassembly" (on page 13)
2. Press the two snap tabs, push the bushing downwards and pull to remove.

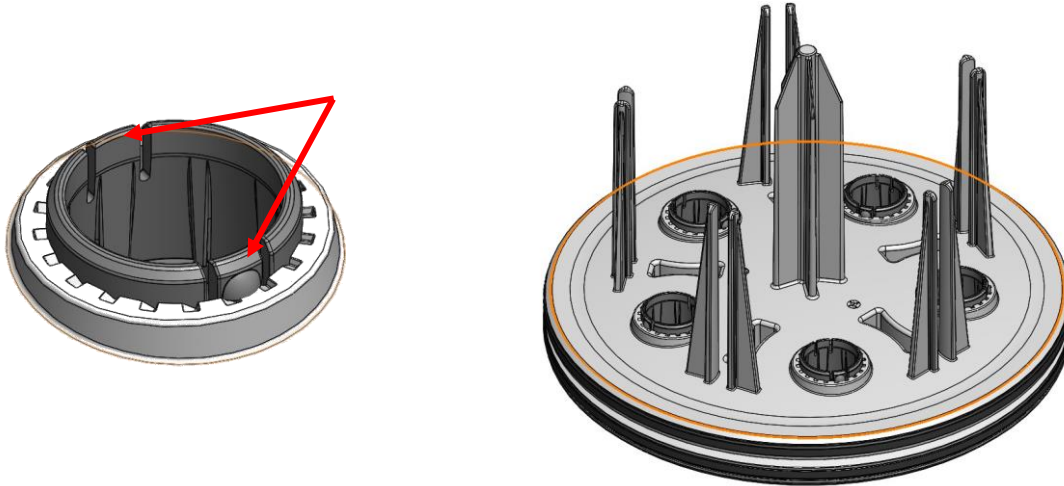

3. To assemble, attach the new bushing to the Sigma Pro multi-tool and insert into top plate. Rotate and click to lock.

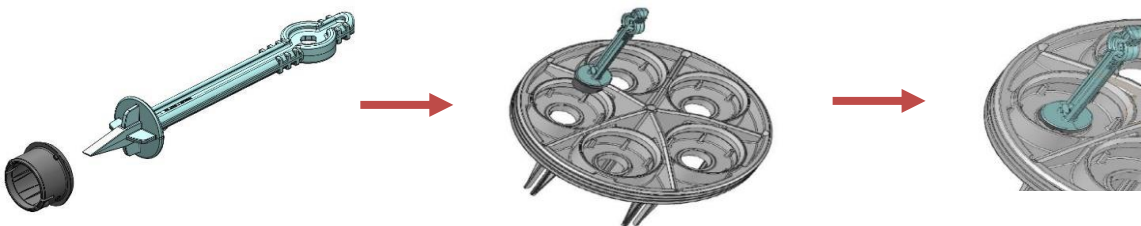


Bill of Materials – 4" Electronic

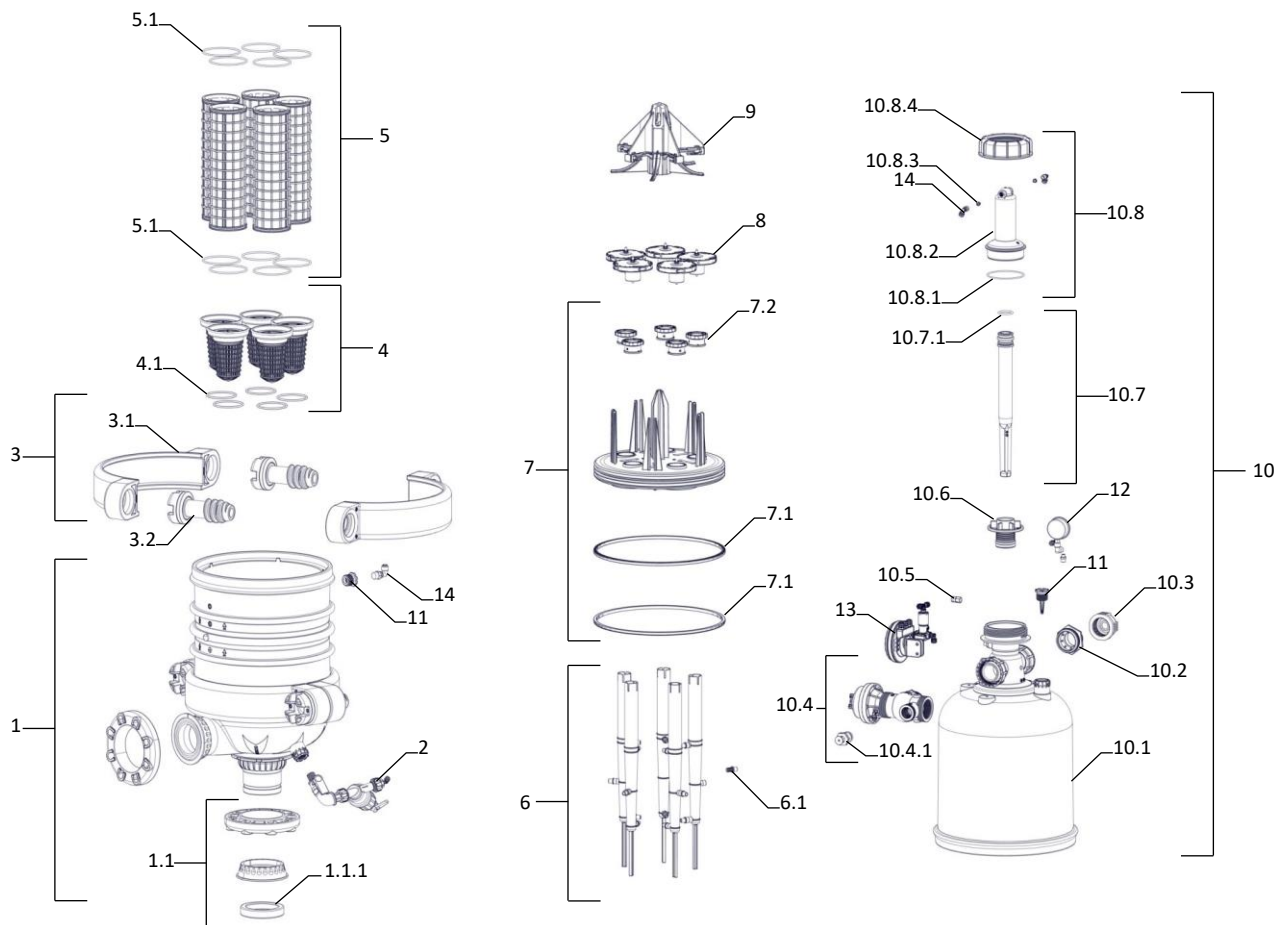


ITEM NO.	PART NUMBER	DESCRIPTION	QTY	ITEM NO.	PART NUMBER	DESCRIPTION	QTY
1	700190-004220	BODY W/SLEEVE ASSEMBLY F/4" SIGMA/AKF	1	10.1	700190-004685	COVER W/DRAIN BODY ASSEMBLY F/SIGMA 4"/6"/8"	1
1.1	700190-000227	4" AKF UNIVERSAL ASSEMBLY	2	10.2	700190-000195	ADAPTOR ASSY NUT+SEALS	1
1.1.1	770104-000253	GASKET 4" EPDM 70 SHORE QUICK FLANGE	1	10.3	700190-001241	CAP ASSEMBLY 2"IT BSP	1
2	700190-004877	1" CONTROL FILTER ASSY 8MM TF F/SIGMA	1	10.4	700190-004807	POLYMERIC FLUSH VALVE ASSEMBLY 2"NC BSP STD	1
3	700190-004133	CLAMP ASSEMBLY FOR 4"GALAXY/SIGMA	1	10.4.1	700190-003406	1" VACUUM BREAKER	1
3.1	710103-005220	CLAMP 4" GALAXY/SIGMA RPA W/O RUNNER	2	10.5	720501-000134	STRAIGHT CONNECTOR 1/4"X 8MM BSPT RPP BLACK TEFEN	1
3.2	700190-005415	SET SCREW WASHER F/CLAMP SIGMA PRO ASSY	2	10.6	700190-005420	PISTON BUSHING ASSEMBLY W/ O-RINGS F/SIGMA PRO ASSY	1
4	700190-004222	BOTTOM W/PRESCREEN ASSEMBLY F/4" SIGMA	5	10.7	700190-005441	PISTON W/U-CUP SEAL F/SIGMA PRO ASSY	1
4.1	770102-000034	PARKER O-RING 2-237 EPDM 70 SHORE YELLOW DOT	1	10.7.1	770105-000011	U-CUP SEAL NBR OD50MM ID40MM H7MM 70 SHORE	1
5	700101-001505	MOLDED WEAVEWIRE SCREEN S/ST316L 130MIC SIGMA W/O-RINGS	5	10.8	700190-005421	PISTON CYLINDER ASSEMBLY F/SIGMA PRO ASSY	1
5.1	770102-000384	PARKER O-RING 2-244 EPDM 70 SHORE YELLOW DOT	2	10.8.1	770102-000027	PARKER O-RING 2-156 EPDM 70 SHORE YELLOW DOT	1
6	700190-005106	SCANNER 375 ASSEMBLY W/STRAIGHT NOZZLE 8MM F/SIGMA 4"	5	10.8.2	710101-001295	SIGMA PISTON CYLINDER PBT BLACK	1
6.1	700190-005419	SET STRAIGHT NOZZLE 8MM HDPE RED F/SIGMA PRO	5	10.8.3	710101-001308	SIGMA PISTON NOZZLE 1.2 MM PP RED	2
7	700190-005418	UPPER PLATE ASSEMBLY F/SIGMA PRO	1	10.8.4	710103-010056	PISTON HOUSING EXTERNAL NUT SIGMA PRO RPA	1
7.1	770104-000311	HYDRAULIC SEAL EPDM SIGMA	2	11	700190-000206	1"*1/4" BUSHING + SEAL	2
7.2	710101-001444	SIGMA PRO BUSHING PBT BLACK	5	12	700190-001980	PRESSURE GAUGE COMPLETE F/2" TEF8	1
8	700190-005150	TURBINE ASSEMBLY F/MINI AND PRO SIGMA	5	13	700103-001749	ADI-P DC KIT PACKAGE	1
9	700190-005416	BRIDGE ASSEMBLY W/CLIPS F/SIGMA PRO ASSY	1	14	720501-000139	L-CONNECTOR 1/4"X 8MM BSPT ACETAL BLACK TEFEN	3
10	700190-004641	FLUSHING ASSEMBLY F/SIGMA 4"/6"/8"	1				

Bill of Materials – 6" Electronic

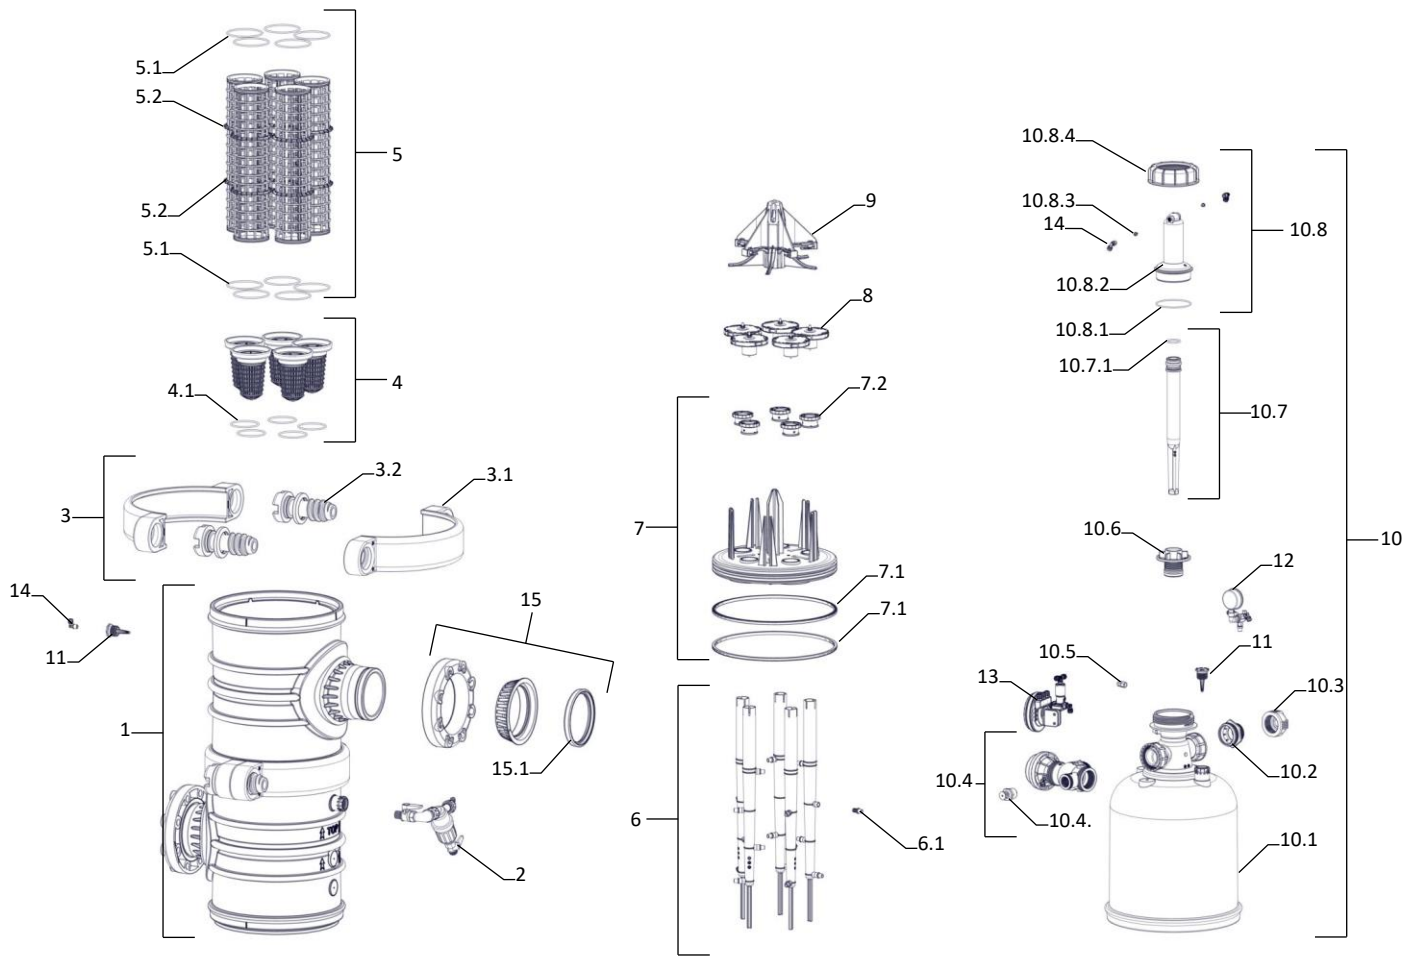

ITEM NO.	PART NUMBER	DESCRIPTION	QTY	ITEM NO.	PART NUMBER	DESCRIPTION	QTY
1	700190-005116	BODY W/SLEEVE ASSEMBLY F/SIGMA 6"VIC	1	10.2	700190-000195	ADAPTOR ASSY NUT+SEALS	1
2	700190-004877	1" CONTROL FILTER ASSY 8MM TF F/SIGMA	1	10.3	700190-001241	CAP ASSEMBLY 2" T BSP	1
3	700190-004133	CLAMP ASSEMBLY FOR 4" GALAXY/SIGMA	1	10.4	700190-004807	POLYMERIC FLUSH VALVE ASSEMBLY 2" NC BSP STD	1
3.1	710103-005220	CLAMP 4" GALAXY/SIGMA RPA	2	10.4.1	700190-003406	1" VACUUM BREAKER	1
3.2	700190-005415	SET SCREW WASHER F/CLAMP SIGMA PRO ASSY	2	10.5	720501-000134	STRAIGHT CONNECTOR 1/4" F X 8MM BSPT RPP BLACK TEFEN	1
4	700190-004222	BOTTOM W/PRESCREEN ASSEMBLY F/4" SIGMA	5	10.6	700190-005420	PISTON BUSHING ASSEMBLY W/ O-RINGS F/SIGMA PRO ASSY	1
4.1	770102-000034	PARKER O-RING 2-237 EPDM 70 SHORE YELLOW DOT	1	10.7	700190-005441	PISTON W/U-CUP SEAL F/SIGMA PRO ASSY	1
5	700101-001534	MOLDED WEAVEWIRE SCREEN S/ST316L 130MIC 6"-8" SIGMA EPDM SEALS	5	10.7.1	770105-000011	U-CUP SEAL NBR OD50MM ID40MM H7MM 70 SHORE	1
5.1	770102-000384	PARKER O-RING 2-244 EPDM 70 SHORE YELLOW DOT	2	10.8	700190-005421	PISTON CYLINDER ASSEMBLY F/SIGMA PRO ASSY	1
5.2	710101-001380	SIGMA SCREEN SUPPORT RING RPP GREY	4	10.8.1	770102-000027	PARKER O-RING 2-156 EPDM 70 SHORE YELLOW DOT	1
6	700190-005105	SCANNER 500 ASSEMBLY W/STRAIGHT NOZZLE 8MM F/SIGMA 6"/8"	5	10.8.2	710101-001295	SIGMA PISTON CYLINDER PBT BLACK	1
6.1	700190-005419	SET STRAIGHT NOZZLE 8MM HDPE RED F/SIGMA PRO	5	10.8.3	710101-001308	SIGMA PISTON NOZZLE 1.2 MM PP RED	2
7	700190-005418	UPPER PLATE ASSEMBLY F/SIGMA PRO	1	10.8.4	710103-010056	PISTON HOUSING EXTERNAL NUT SIGMA PRO RPA	1
7.1	770104-000311	HYDRAULIC SEAL EPDM SIGMA	2	11	700190-000206	1" * 1/4" BUSHING + SEAL	2
7.2	710101-001444	SIGMA PRO BUSHING PBT BLACK	5	12	700190-001980	PRESSURE GAUGE COMPLETE F/2" TEF8	1
8	700190-005150	TURBINE ASSEMBLY F/MINI AND PRO SIGMA	5	13	700103-001749	ADI-P DC KIT PACKAGE	1
9	700190-005416	BRIDGE ASSEMBLY W/CLIPS F/SIGMA PRO ASSY	1	14	720501-000139	L-CONNECTOR 1/4" M X 8MM BSPT ACETAL BLACK TEFEN	3
10	700190-004641	FLUSHING ASSEMBLY F/SIGMA 4"/6"/8"	1	15	700190-000238	6" AKF UNIVERSAL	2
10.1	700190-004685	COVER W/DRAIN BODY ASSEMBLY F/SIGMA 4"/6"/8"	1	15.1	770104-000036	GASKET 6" EPDM 70 SHORE QUICK FLANGE	1


Bill of Materials – 8" Electronic

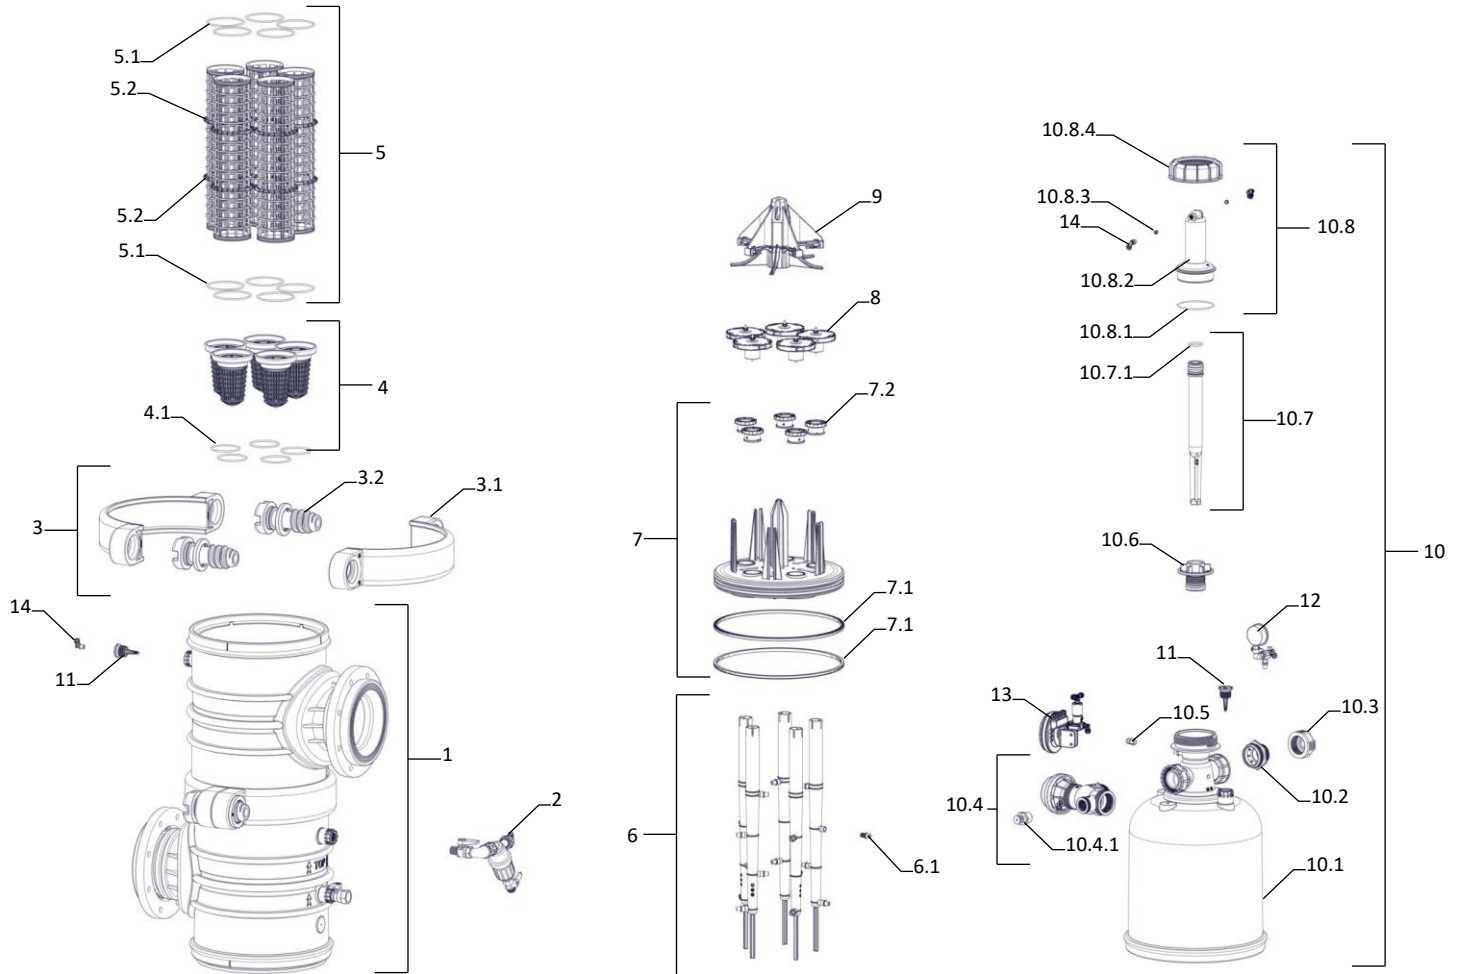


ITEM NO.	PART NUMBER	DESCRIPTION	QTY	ITEM NO.	PART NUMBER	DESCRIPTION	QTY
1	700190-004635	BODY W/SLEEVE ASSEMBLY F/SIGMA 8" ASA	1	10.1	700190-004685	COVER W/DRAIN BODY ASSEMBLY F/SIGMA 4"/6"/8"	1
	700190-004636	BODY W/SLEEVE ASSEMBLY F/SIGMA 8"BSTD	1	10.2	700190-000195	ADAPTOR ASSY NUT+SEALS	1
2	700190-004877	1" CONTROL FILTER ASSY 8MM TF F/SIGMA	1	10.3	700190-001241	CAP ASSEMBLY 2" T BSP	1
3	700190-004133	CLAMP ASSEMBLY FOR 4" GALAXY/SIGMA	1	10.4	700190-004807	POLYMERIC FLUSH VALVE ASSEMBLY 2" NC BSP STD	1
3.1	710103-005220	CLAMP 4" GALAXY/SIGMA RPA W/O RUNNER	2	10.4.1	700190-003406	1" VACUUM BREAKER	1
3.2	700190-005415	SET SCREW WASHER F/CLAMP SIGMA PRO ASSY	2	10.5	720501-000134	STRAIGHT CONNECTOR 1/4" F X 8MM BSPT RPP BLACK TEFEN	1
4	700190-004222	BOTTOM W/PRESCREEN ASSEMBLY F/4" SIGMA	5	10.6	700190-005420	PISTON BUSHING ASSEMBLY W/ O-RINGS F/SIGMA PRO ASSY	1
4.1	770102-000034	PARKER O-RING 2-237 EPDM 70 SHORE YELLOW DOT	1	10.7	700190-005441	PISTON W/U-CUP SEAL F/SIGMA PRO ASSY	1
5	700101-001534	MOLDED WEAWEWIRE SCREEN S/ST316L 130MIC 6"-8" SIGMA EPDM SEALS	5	10.7.1	770105-000011	U-CUP SEAL NBR OD50MM ID40MM H7MM 70 SHORE	1
5.1	770102-000384	PARKER O-RING 2-244 EPDM 70 SHORE YELLOW DOT	2	10.8	700190-005421	PISTON CYLINDER ASSEMBLY F/SIGMA PRO ASSY	1
5.2	710101-001380	SIGMA SCREEN SUPPORT RING RPP GREY	4	10.8.1	770102-000027	PARKER O-RING 2-156 EPDM 70 SHORE YELLOW DOT	1
6	700190-005105	SCANNER 500 ASSEMBLY W/STRAIGHT NOZZLE 8MM F/SIGMA 6"/8"	5	10.8.2	710101-001295	SIGMA PISTON CYLINDER PBT BLACK	1
6.1	700190-005419	SET STRAIGHT NOZZLE 8MM HDPE RED F/SIGMA PRO	5	10.8.3	710101-001308	SIGMA PISTON NOZZLE 1.2 MM PP RED	2
7	700190-005418	UPPER PLATE ASSEMBLY F/SIGMA PRO	1	10.8.4	710103-010056	PISTON HOUSING EXTERNAL NUT SIGMA PRO RPA	1
7.1	770104-000311	HYDRAULIC SEAL EPDM SIGMA	2	11	700190-000206	1" * 1/4" BUSHING + SEAL	2
7.2	710101-001444	SIGMA PRO BUSHING PBT BLACK	5	12	700190-001980	PRESSURE GAUGE COMPLETE F/2" TEF8	1
8	700190-005150	TURBINE ASSEMBLY F/MINI AND PRO SIGMA	5	13	700103-001749	ADI-P DC KIT PACKAGE	1
9	700190-005416	BRIDGE ASSEMBLY W/CLIPS F/SIGMA PRO ASSY	1	14	720501-000139	L-CONNECTOR 1/4" M X 8MM BSPT ACETAL BLACK TEFEN	3
10	700190-004641	FLUSHING ASSEMBLY F/SIGMA 4"/6"/8"	1				

Sigma Pro – Installations of Multiple Units

Sigma Pro 8" installation of 4 units with manifold,
for flow rates up to 1,120 m³/h (4,932 gpm)

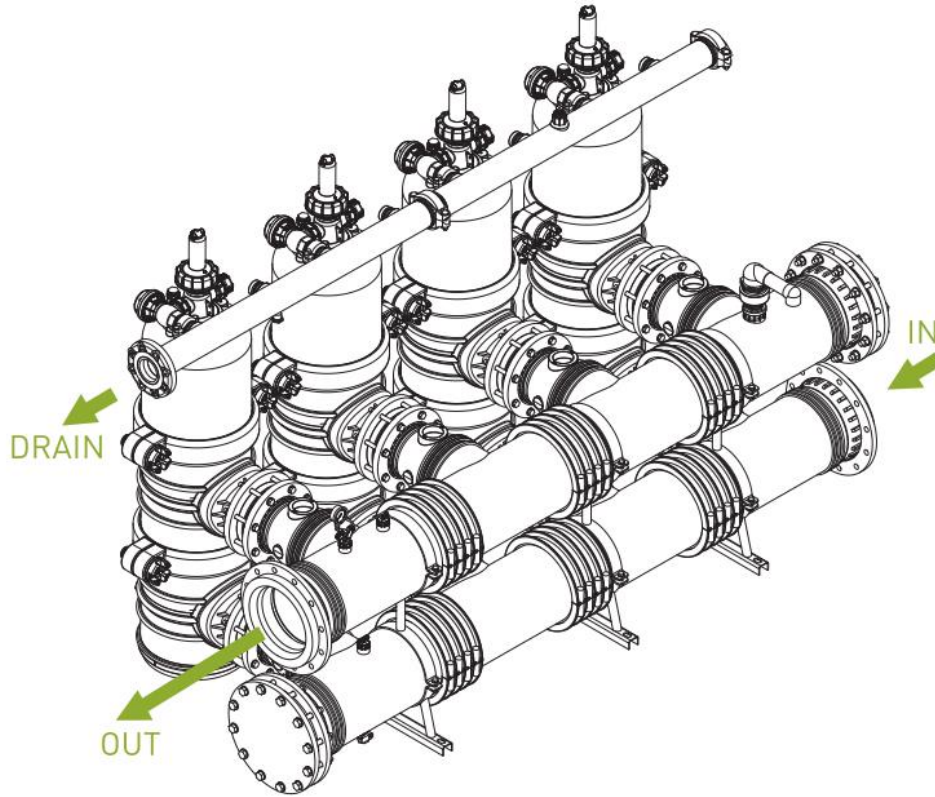

Sigma Pro 6" installation of 2 units with manifold,
for flow rates up to 360 m³/h (1,584 gpm)

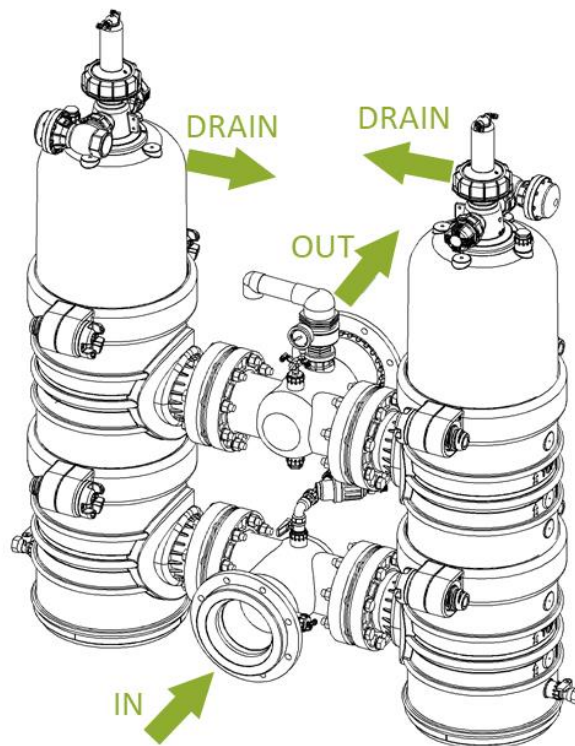

Control Schematic - Electronic Model

LEGEND:

PG - PRESSURE GAUGE

SV - SOLENOID VALVE 12v DC LATCH

HV - HYDRAULIC VALVE

SYMBOLS :


COMMAND — 8 mm
 HP — 8 mm
 LP — 8 mm
 VENT — 8 mm
 ELECTRIC — 8 mm

- PRESSURE GAUGE

- 3-WAY BALL VALVE

- 2-WAY HYDRAULIC VALVE


- 3/2 SOLENOID VALVE

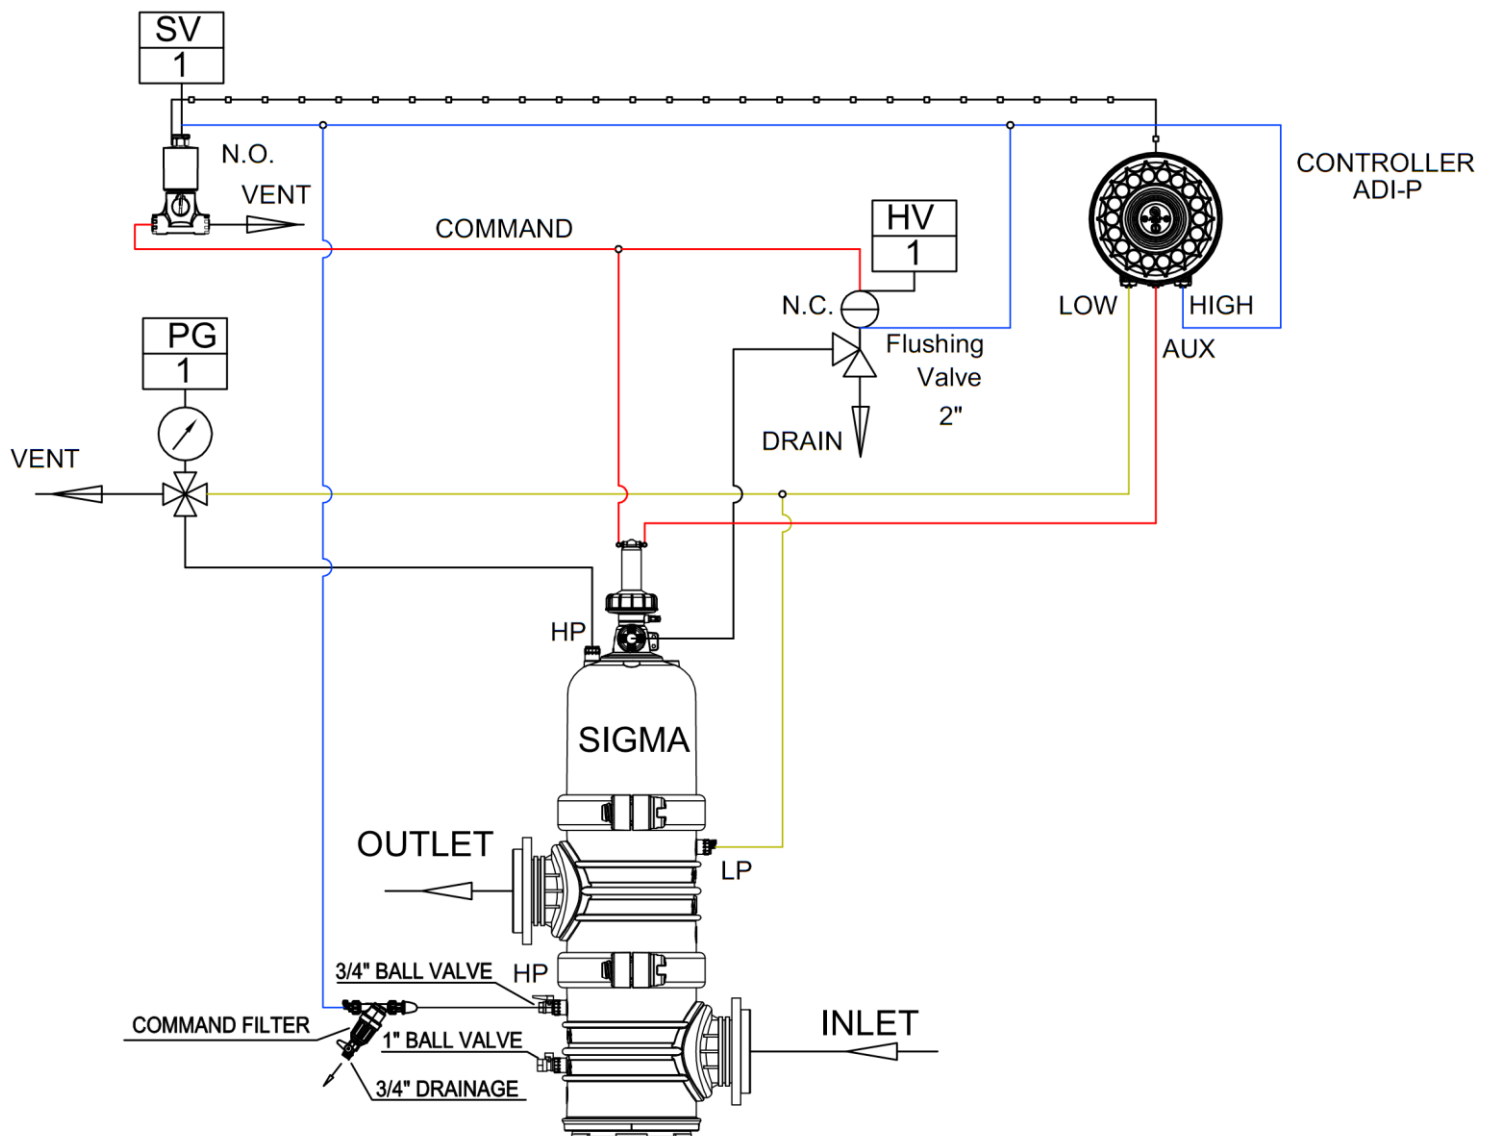

Control Schematic - Electronic Model for 3 Units


SYMBOLS :

COMMAND		8 mm
FEED WATER/HP		8 mm
LP		8 mm
VENT		8 mm
ELECTRIC		

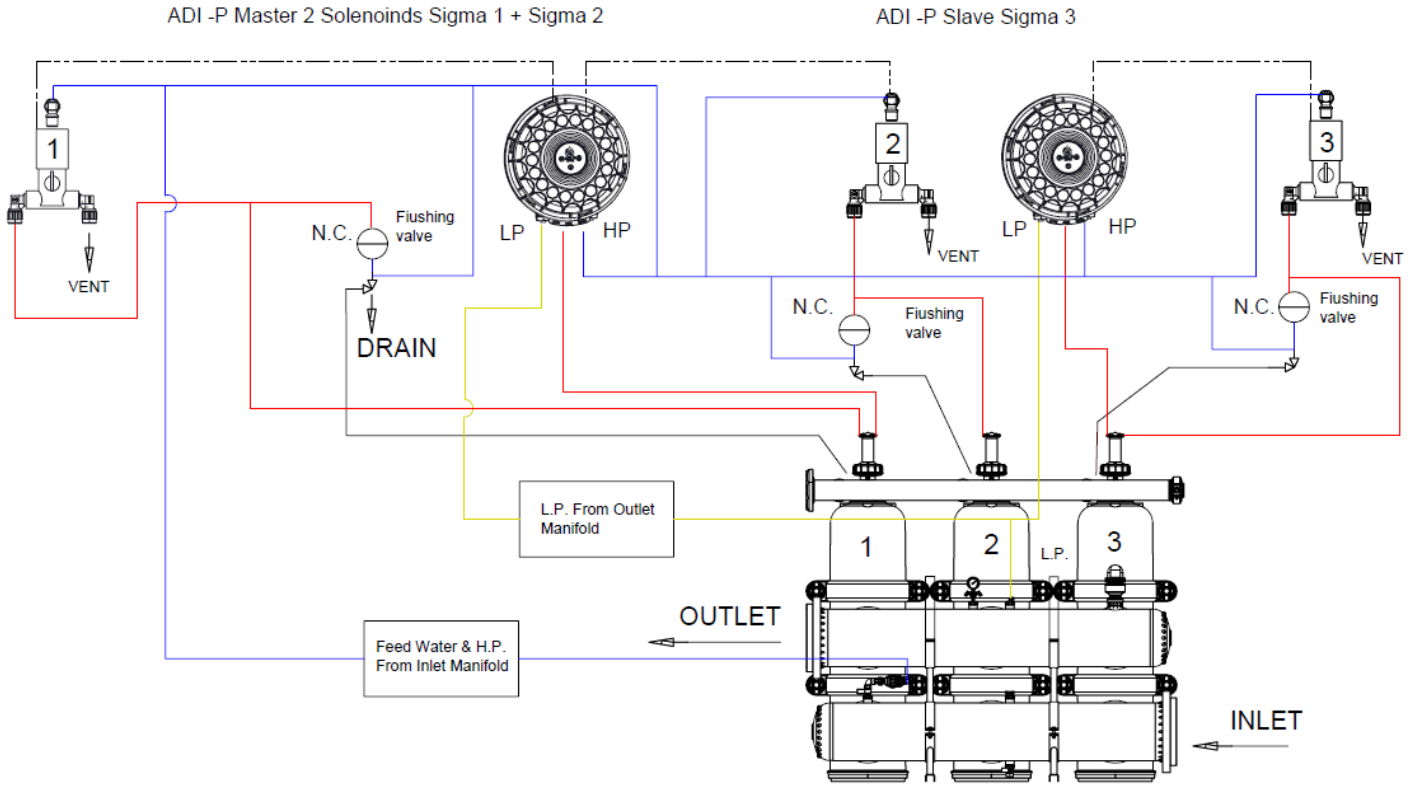

Adi-p Master 2 solenoids

Adi-p slave

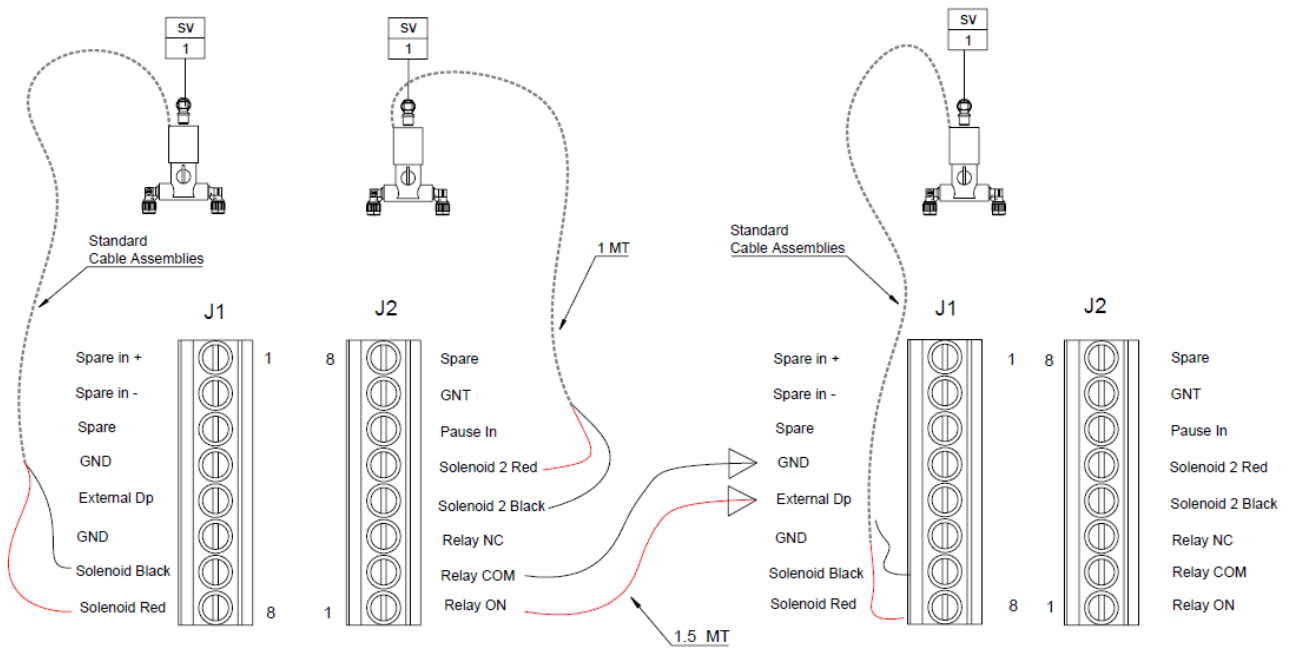


Control Schematic - Electronic Model for 4 Units

SYMBOLS :

COMMAND		8 mm
FEED WATER/HP		8 mm
LP		8 mm
VENT		8 mm
ELECTRIC		


ADI -P Master 2 Solenoids Sigma 1 + Sigma 2

ADI -P Slave 2 Solenoids Sigma 3 + Sigma 4

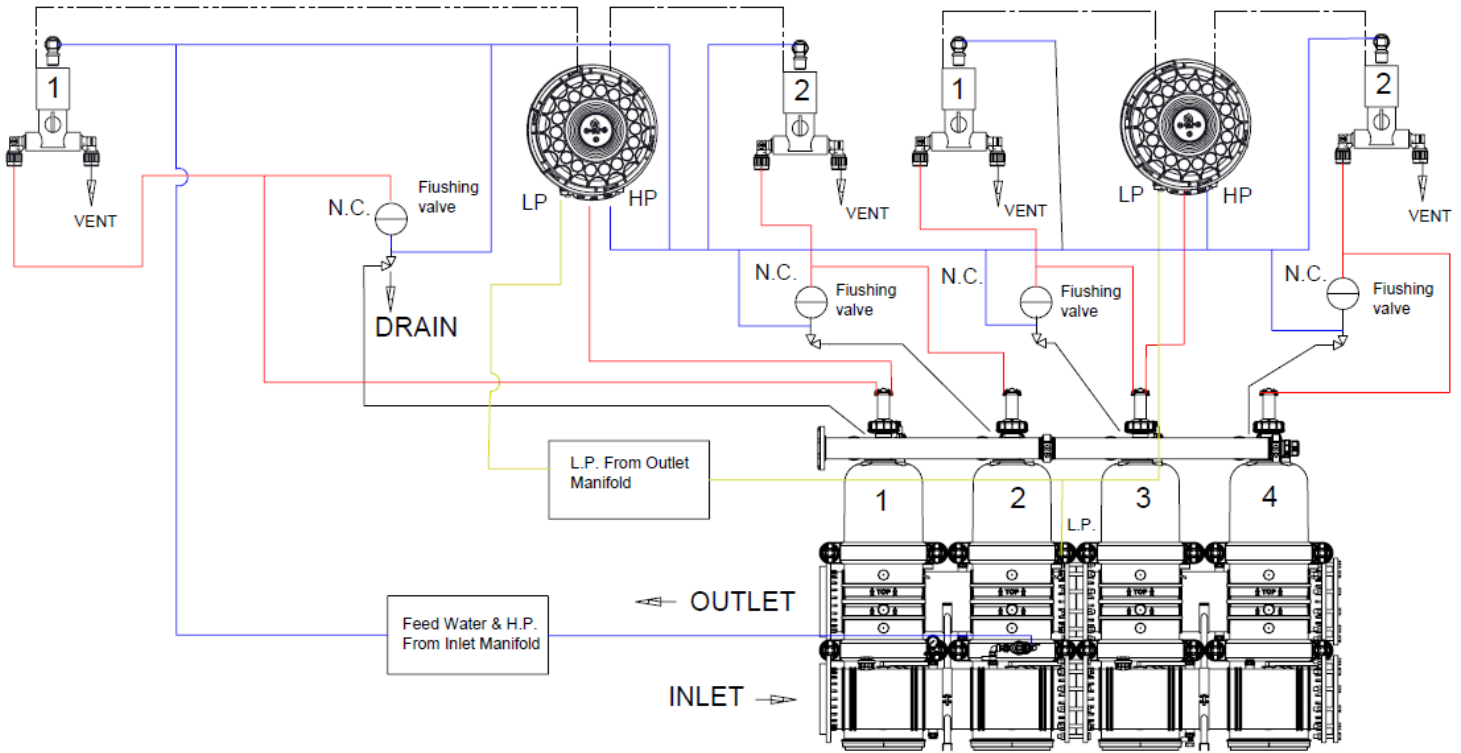

ADI -P Master 2 Solenoids Sigma 1 + Sigma 2

ADI -P Slave 2 Solenoids Sigma 3 + Sigma 4

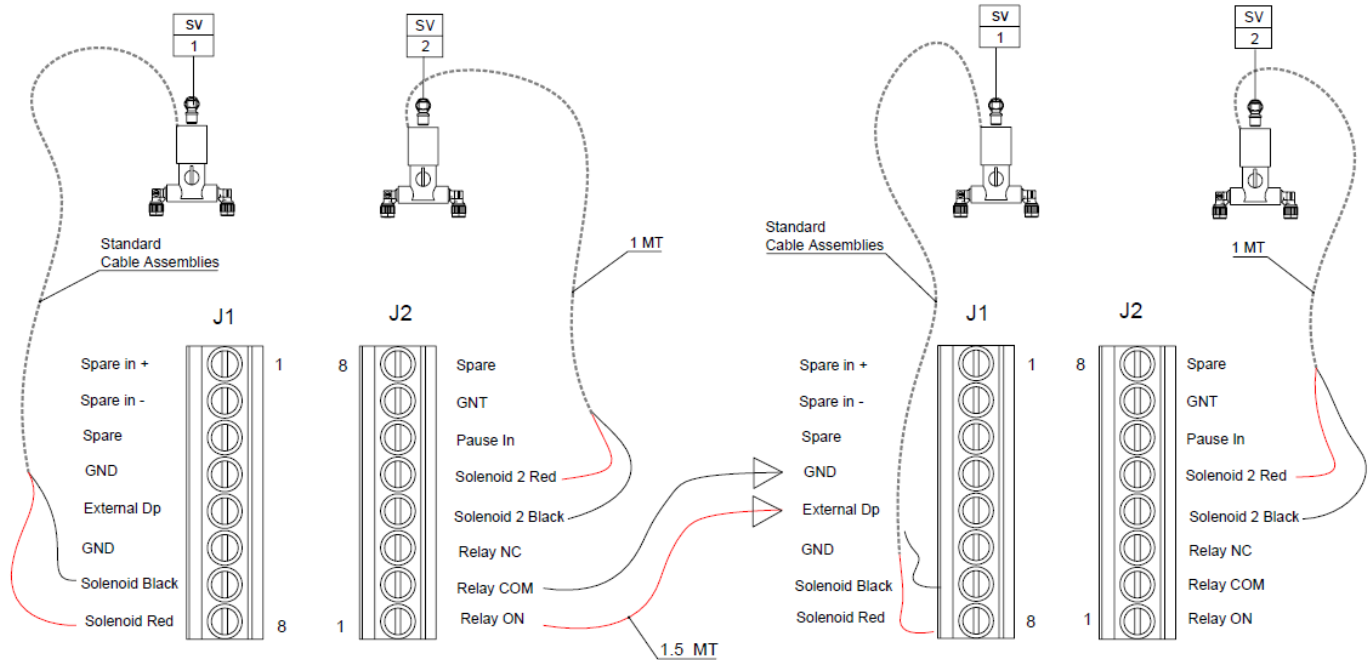


Control Schematic - Electronic Model for Multiple Units

LEGEND :

- B.L. - BATTERY LIMITS
- CF - CONTROL FILTER
- PG - PRESSURE GAUGE
- SV - SOLENOID VALVE
- FV - FLUSHING VALVE

SYMBOLS :

- | | | |
|---------------|---|------|
| COMMAND | — | 8 mm |
| FEED WATER/HP | — | 8 mm |
| LP | — | 8 mm |
| VENT | — | 8 mm |
| ELECTRIC | — □ — | |

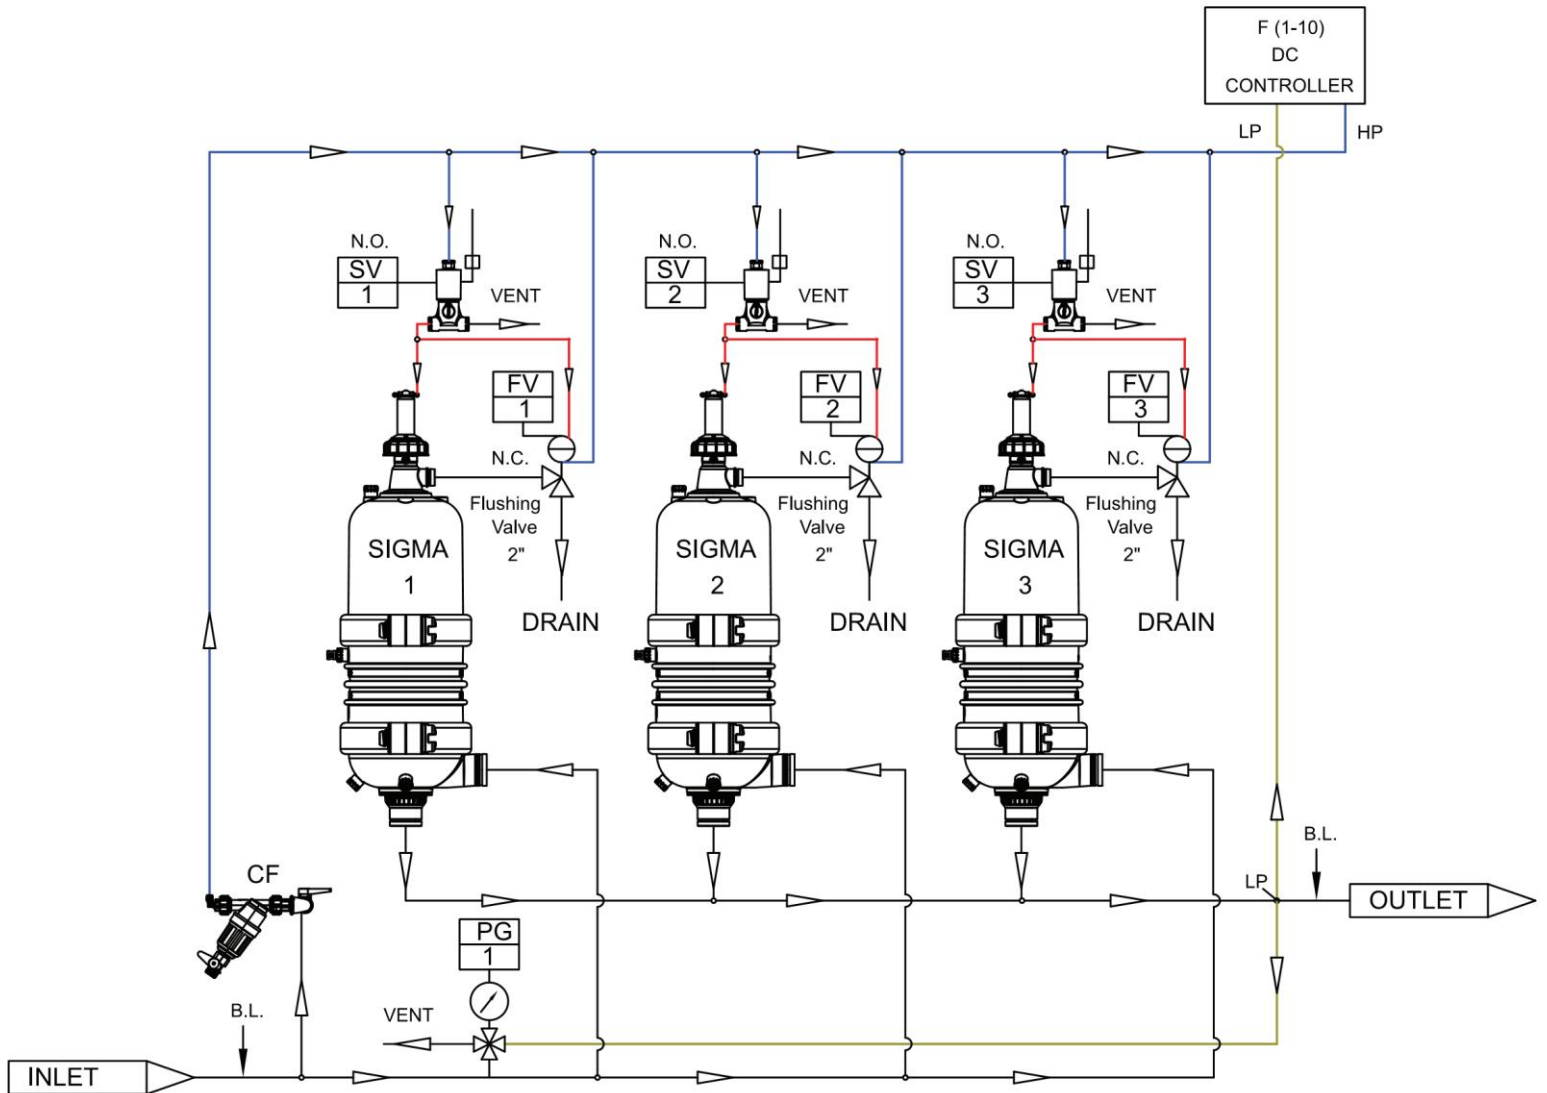

Troubleshooting

No.	Symptom	Possible Causes	Required Action
1	High or elevated pressure differential between upstream and downstream	Coarse or fine screens are totally clogged	<ol style="list-style-type: none"> Perform automatic flushing <ol style="list-style-type: none"> Close the downstream valve Start a manual flush cycle using the flushing controller. Verify that the downstream pressure is equal or slightly lower than the upstream pressure If symptom continues and the filter remains clogged, stop the operation and manually clean the fine screen Perform manual flushing <ol style="list-style-type: none"> Extract the coarse and fine screens. Clean manually with a high pressure wash before returning to regular operation. Please refer to filter disassembly instruction on page 21 Verify that the downstream pressure is equal to or slightly lower than the upstream pressure
2	System flow rate seems to be lower than usual	Coarse screens are clogged	Manually clean the coarse screens: <ol style="list-style-type: none"> Dismantle the coarse screens. Please refer to filter disassembly instruction on page 21 Return to regular operation and check the filter's performance
3	Frequent/excessive flush cycles	Water quality has changed	Check the source water quality for poor quality conditions (e.g. flood, heavy rain, works upstream of intake, new dam)
		Controller flush duration set-point too low (electronic control)	Check the "Flush Duration"- set-point 10 seconds
4	The filter doesn't flush automatically (electronic controller)	Controller batteries are dead, or power supply is isolated	Check battery status by ADI-P mobile app. Replace the controller's batteries if needed
		The solenoid is set in manual position	Switch the solenoid to "Auto" position
		No pressure on the main command tube line	Rinse and clean the command line filter (if it exists), otherwise check the finger filter for blockage and clean as required
		The controller is in "Fault" mode	Please see ADI-P controller manual "DP Fault" parameter is set to an appropriate value (AMC Controller)
5	The flush valve remains open	Air in the valve's command line or control tube is disconnected	<ol style="list-style-type: none"> Bleed air from the control tubing Reconnect control tube Replace control tube if damaged Electronic controller – check the solenoid, bleed the command line, and verify that the controller is not in "Flushing" mode
		The solenoid manual override is activated	Switch the solenoid to "Auto" position
		Controller programmed for a very long flush duration (electronic controller)	Check the "Flush Duration"- set-point 10 seconds
		Blocked flush port	Remove any blockage from the flush port


Amiad Limited Warranty

1. This certificate applies to Amiad Water Systems Ltd. ("**Amiad**") products purchased by you (the "**Buyer**") from Amiad unless specifically agreed otherwise in writing by Amiad. This Warranty extends only to the original purchaser, and is not transferable to anyone who subsequently purchases, leases, or otherwise obtains the product from the original purchaser.
2. Amiad hereby warrants that the products are and will be free from defects in material and workmanship under normal use and service. Amiad warrants that it will correct manufacturing defects in the products, in accordance with the conditions set out in this Warranty.
3. This Warranty is enforceable for a period of 12 months after the date upon which the products were delivered (the "**Warranty Period**").
4. In the event that during the Warranty Period the Buyer discovers a defect in material and/or workmanship in any product or part (the "**Defective Product**"), it shall submit a written complaint to Amiad using Amiad's standard Buyer Complaint Form. For the receipt of the Buyer Complaint Form, the submission of the complaint or any questions please contact your service representative.
5. Upon written demand by Amiad the Buyer shall return the Defective Product - or a sample thereof - to Amiad, at Amiad's cost. If the Buyer ships any such Defective Product, Amiad suggests the Buyer package it securely and insure it for value, as Amiad assumes no liability for any loss or damage occurring during shipment. Provided however that in the event Amiad determines that this Warranty does not apply to such product, Buyer shall promptly reimburse Amiad for such cost (including freight and customs). Any returned product or part must be accompanied by the Warranty certificate and the purchase invoice. It is clarified that the Buyer may not return the Defective Product unless such return was coordinated and approved by Amiad in advance.
6. Amiad's obligation under this Warranty shall be limited to, at Amiad's option, the repair or exchange, free of charge, of the product or any part which may prove defective under normal use and service during the Warranty Period. The provision of a repair or replacement of a product during the Warranty Period will result in an extension of the Warranty Period by an additional period of 12 months, provided that the total accumulated Warranty Period shall in any event be no more than 18 months from the date upon which the products were delivered.
7. This Warranty is valid on the condition that the products are installed according to Amiad's instructions as expressed in Amiad's instruction manuals and according to the technical limitations as stipulated in Amiad's literature or as stated by a representative of Amiad.
8. This Warranty will not apply to damaged or defective products resulting from or related to:
 - (i) Fire, flood, power surges or failures or any other catastrophe and/or unforeseen occurrence, such as but not limited to those for which the Buyer is customarily insured for, or any force majeure events;
 - (ii) Fault, abuse or negligence of the Buyer;
 - (iii) Intake water not meeting the agreed standards, as set forth in a written document, approved by Amiad, or improper storage;
 - (iv) Improper or unauthorized use of the product or related parts by the Buyer, including Buyer's failure to operate the product in conformity with the recommendations and instructions of Amiad, as set forth in Amiad's manuals and other written materials, the operation of the product other than by a trained and qualified operator, or improper installation of the product by a third party not authorized by Amiad;
 - (v) Performance by the Buyer of maintenance or operation other than in conformity with the recommendations and instructions of Amiad, or other than in accordance with procedures defined in the literature supplied for products (including the timely replacement of requisite parts), and for services provided other than by a trained and qualified advanced operator; or
 - (vi) Any alteration, modification, foreign attachment to or repair of the products, other than by Amiad or its authorized technical representatives.
9. In no event shall Amiad be liable to the Buyer or any third party for any damages to property, or for any intangible or economic loss, including loss of profits, loss of customers or damage to reputation, for any damages, including indirect, special, consequential damages, or punitive damage arising out of or in connection with this Warranty, or arising out of or in connection with the product's performance or failure to perform, even if it has been advised of the possibility of such damages.
10. Amiad will be excused for failure to perform or for delay in performance hereunder if such failure or delay is due to causes beyond its reasonable control or force majeure preventing or hindering performance.
11. This Warranty set forth herein is the only contractual warranty given by Amiad and is provided in lieu of any other warranties created by any documentation, packaging or otherwise.
12. Amiad makes no warranty whatsoever in respect to accessories or parts not supplied by Amiad. In the event that Amiad is required to correct a Defective Product or product not covered by this Warranty, it will do so solely in consideration for additional fees.
13. The parties will actively endeavor to amicably settle any dispute arising between them. In the event that the parties are unable to reach an equitable settlement of such dispute, any claim or lawsuit related to the Warranty, its validity execution, its performance be brought before only the courts of Tel-Aviv, Israel. Israeli law will govern the Warranty, to the exclusion of any conflict of law rules.



Manufacturer: Amiad Water Systems Ltd. D.N. Galil Elyon 1, 1233500, Israel.

Tel: +972 4690 9500 | Fax: +972 48141159 | Email: info@amiad.com



EC Representative: Obelis s.a. Bd Général Wahis 53, 1030 Brussels, Belgium.

Tel: +(32) 2732 5954 | Fax: +(32) 27326003 | Email: mail@obelis.net

EC Declaration <https://www.amiad.com/certificatesDownload.asp>